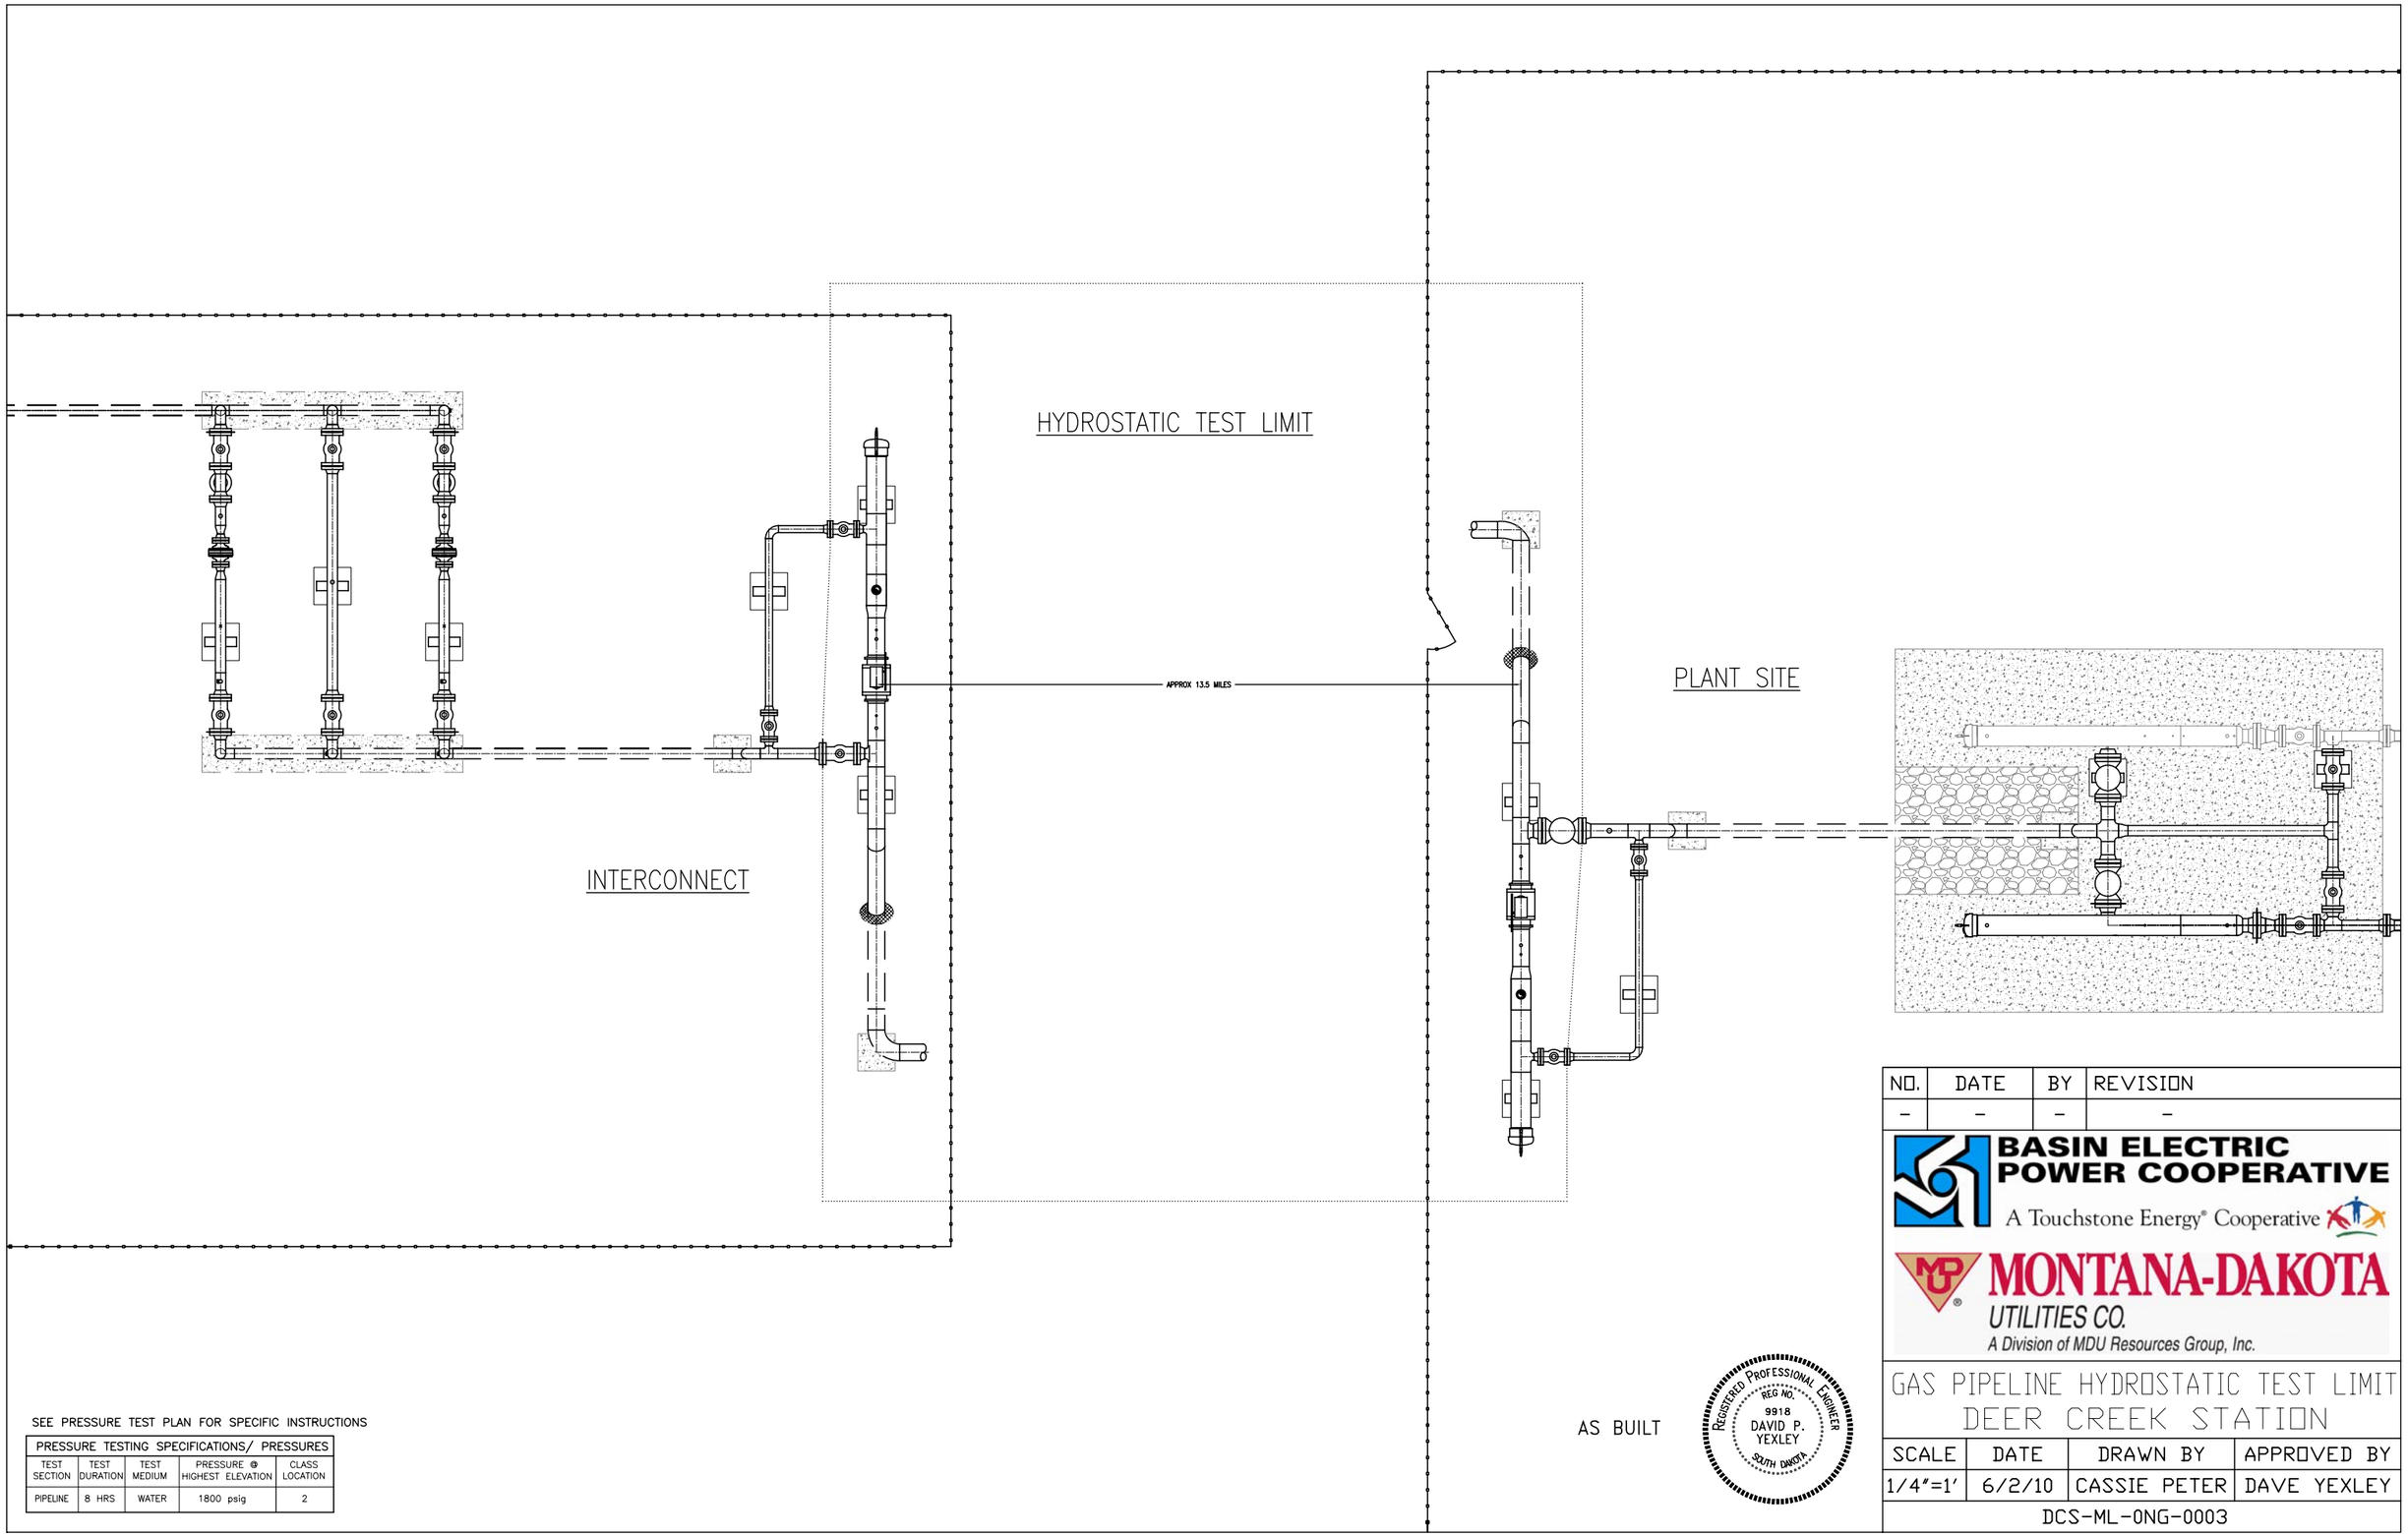


SEE PRESSURE TEST PLAN FOR SPECIFIC INSTRUCTIONS

| PRESSURE TESTING SPECIFICATIONS/ PRESSURES | | | | |
|---|---|---|---|---|
| TEST SECTION | TEST DURATION | TEST MEDIUM | PRESSURE @ HIGHEST ELEVATION | CLASS LOCATION |
| PIPELINE | 8 HRS | WATER | 1800 psig | 2 |

| NO. | DATE | BY | REVISION |
|---|---|---|---|
| – | – | – | – |

BASIN ELECTRIC POWER COOPERATIVE
A Touchstone Energy® Cooperative

MONTANA-DAKOTA UTILITIES CO.
A Division of MDU Resources Group, Inc.

GAS PIPELINE HYDROSTATIC TEST LIMIT
DEER CREEK STATION

| SCALE | DATE | DRAWN BY | APPROVED BY |
|---|---|---|---|
| 1/4"=1' | 6/2/10 | CASSIE PETER | DAVE YEXLEY |

DCS-ML-ONG-0003