

PRELIMINARY CONCEPT

DESIGN ASSUMPTIONS:

- MAXIMUM SPAN: 250'
- 795 KCMIL 26/7 ACSR "DRAKE"

* DIMENSIONS ARE TO ATTACHMENT HOLE.

NOTES:

1. STRUCTURE DIMENSIONS ARE APPROXIMATE. ACTUAL DIMENSIONS MAY VARY.
2. DIMENSIONS ARE TO ATTACHMENT HOLES.
3. DRAWING IS NOT TO EXACT SCALE

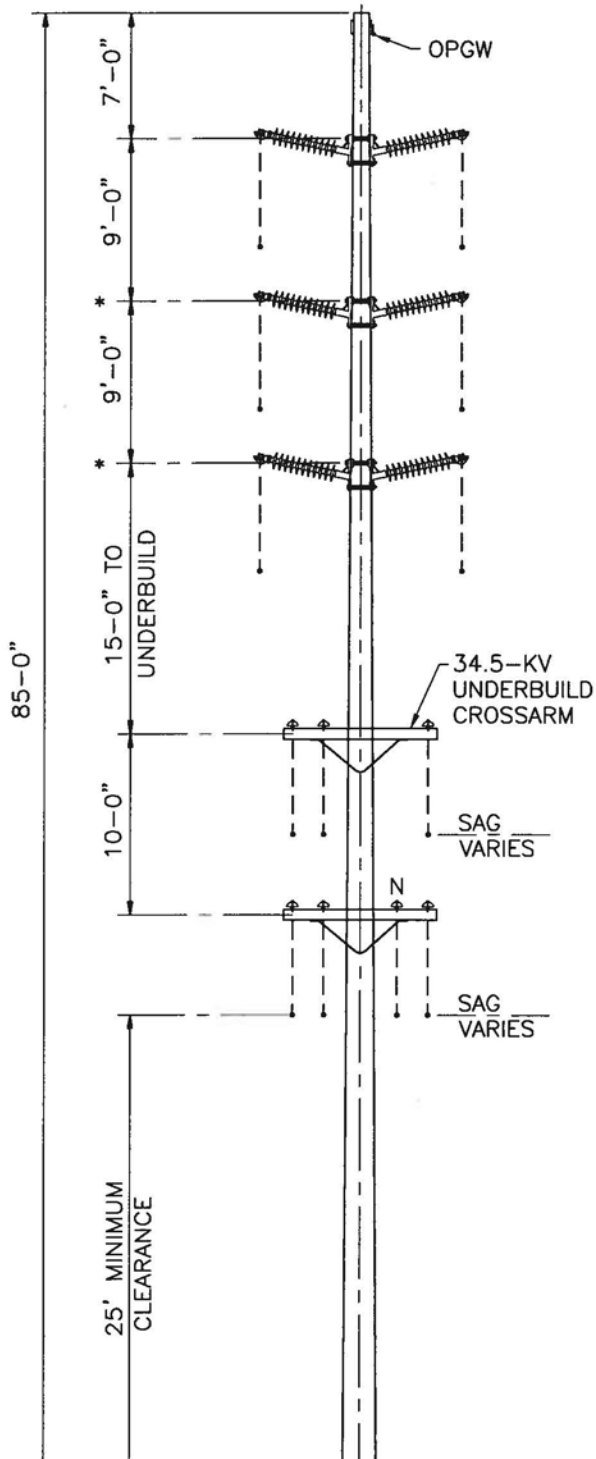


Figure 6f - Typical 115 kV Double Circuit
with Double 34.5 kV Underbuild Structure
Buffalo Ridge II Wind Farm
Iberdrola Renewables
Brookings and Deuel Counties, SD