
Exhibit 19 No. 15

Please refer to NorthWestern's response to Staff Data Request 1-20. 5-7)

a) Please provide a map of each of the proposed network upgrades, including the proposed network substation location as it relates to the existing system.

Original Response of Response of January 3, 2016: a) See attachments 5-7a (1) and 5-7a (2).

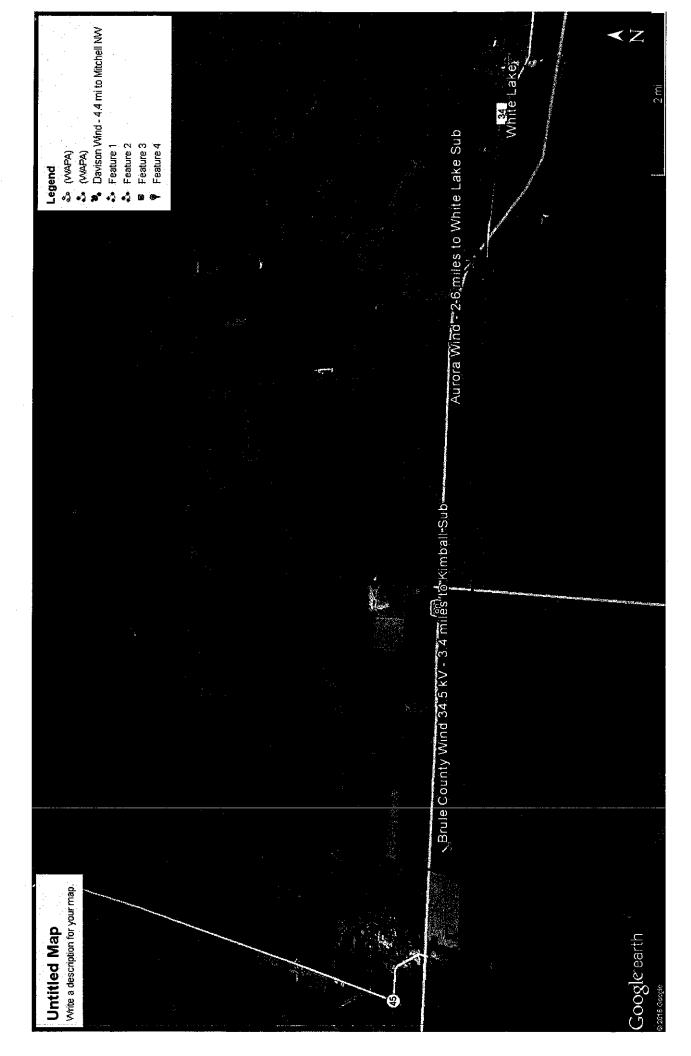

Aurora Wind 69 kV - 2.6 miles to White Lake Subs Brule County Wind 69 kV - 3.4 miles to Kimball Sub-