



www.eapc.net | 701.775.3000

**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines
Overview Map**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.

Predicted sound pressure levels at existing residences and land parcel boundaries.

Additional 2 dBA added.

Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431


Issue Dates

#	Description	Date
1	Original	2019.06.10

Drawn By: AS Checked By: JH

- Legend**
- Crowned Ridge Wind Turbines
 - Crowned Ridge II Wind Turbines
 - Dakota Range Wind Turbines
 - 2 km Turbine Buffer
 - County Lines
 - CR1 Project Boundary
 - Non Participants
 - Participants
- Sound Pressure (dBA)**
- 35
 - 40
 - 45
 - 50
 - 55
- Non-Participating Codington Parcels
 - Participating Codington Parcels
 - Participating Parcels
 - Pending Parcels
 - Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

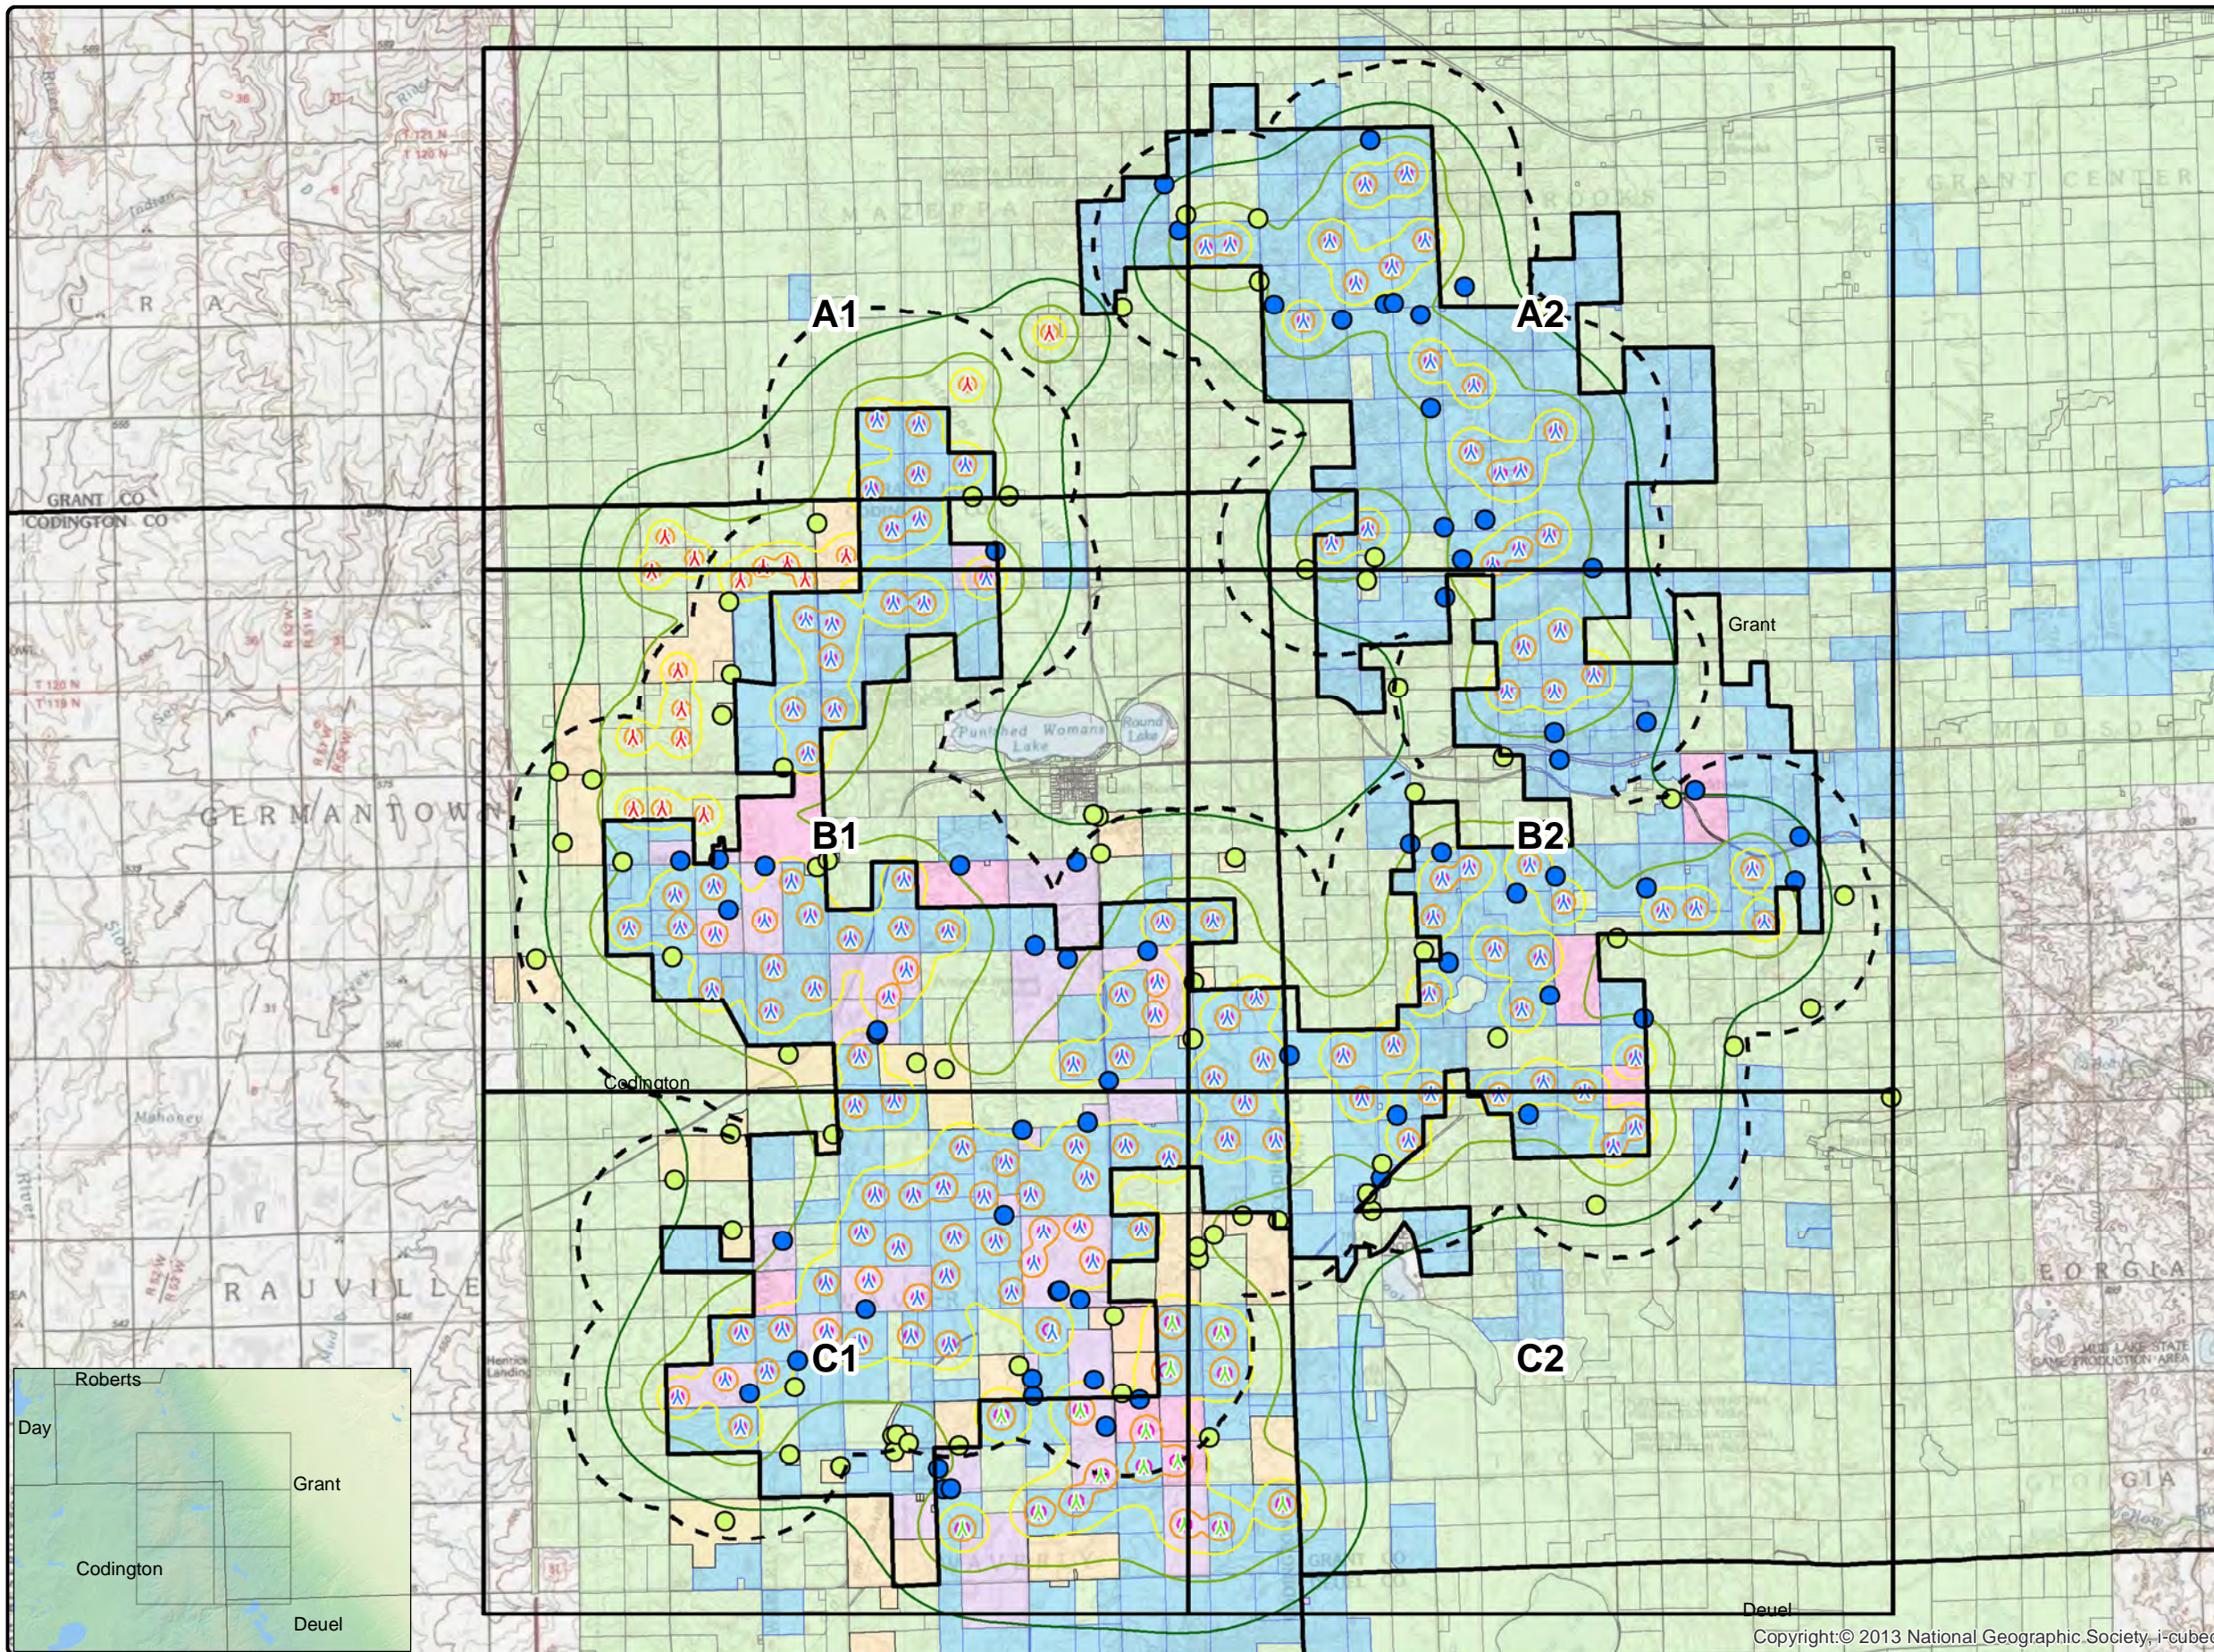

0 0.75 1.5 3 Mile



Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.



www.eapc.net | 701.775.3000

**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.
Predicted sound pressure levels at existing residences and land parcel boundaries.
Additional 2 dBA added.

Predicted sound pressure levels at existing residences and land parcel boundaries.

Additional 2 dBA added.
Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431



Issue Dates

#	Description	Date
1	Original	2019.06.10

Drawn By: AS *Checked By:* JH

- Legend**
- Crowned Ridge Wind Turbines
 - Crowned Ridge II Wind Turbines
 - Dakota Range Wind Turbines
 - 2 km Turbine Buffer
 - County Lines
 - CR1 Project Boundary
 - Non Participants
 - Participants
- Sound Pressure (dBA)**
- 35
 - 40
 - 45
 - 50
 - 55
- Non-Participating Codington Parcels
 - Participating Codington Parcels
 - Participating Parcels
 - Pending Parcels
 - Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

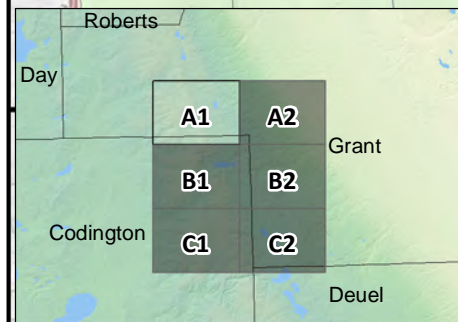

Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.



www.eapc.net | 701.775.3000

**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.
Predicted sound pressure levels at existing residences and land parcel boundaries.
Additional 2 dBA added.
Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431

Issue Dates

1	Original	2019.06.10
#	Description	Date

Drawn By: AS *Checked By:* JH

Legend




- Crowned Ridge Wind Turbines
- Crowned Ridge II Wind Turbines
- Dakota Range Wind Turbines
- 2 km Turbine Buffer
- County Lines
- CR1 Project Boundary
- Non Participants
- Participants

Sound Pressure (dBA)

- 35
- 40
- 45
- 50
- 55

- Non-Participating Codington Parcels
- Participating Codington Parcels
- Participating Parcels
- Pending Parcels
- Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

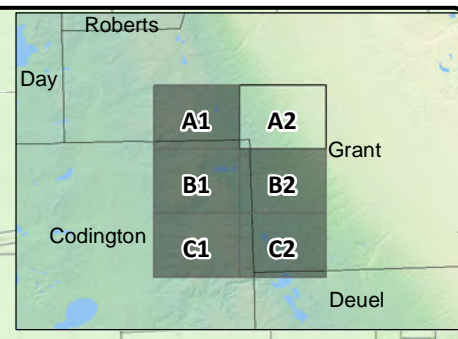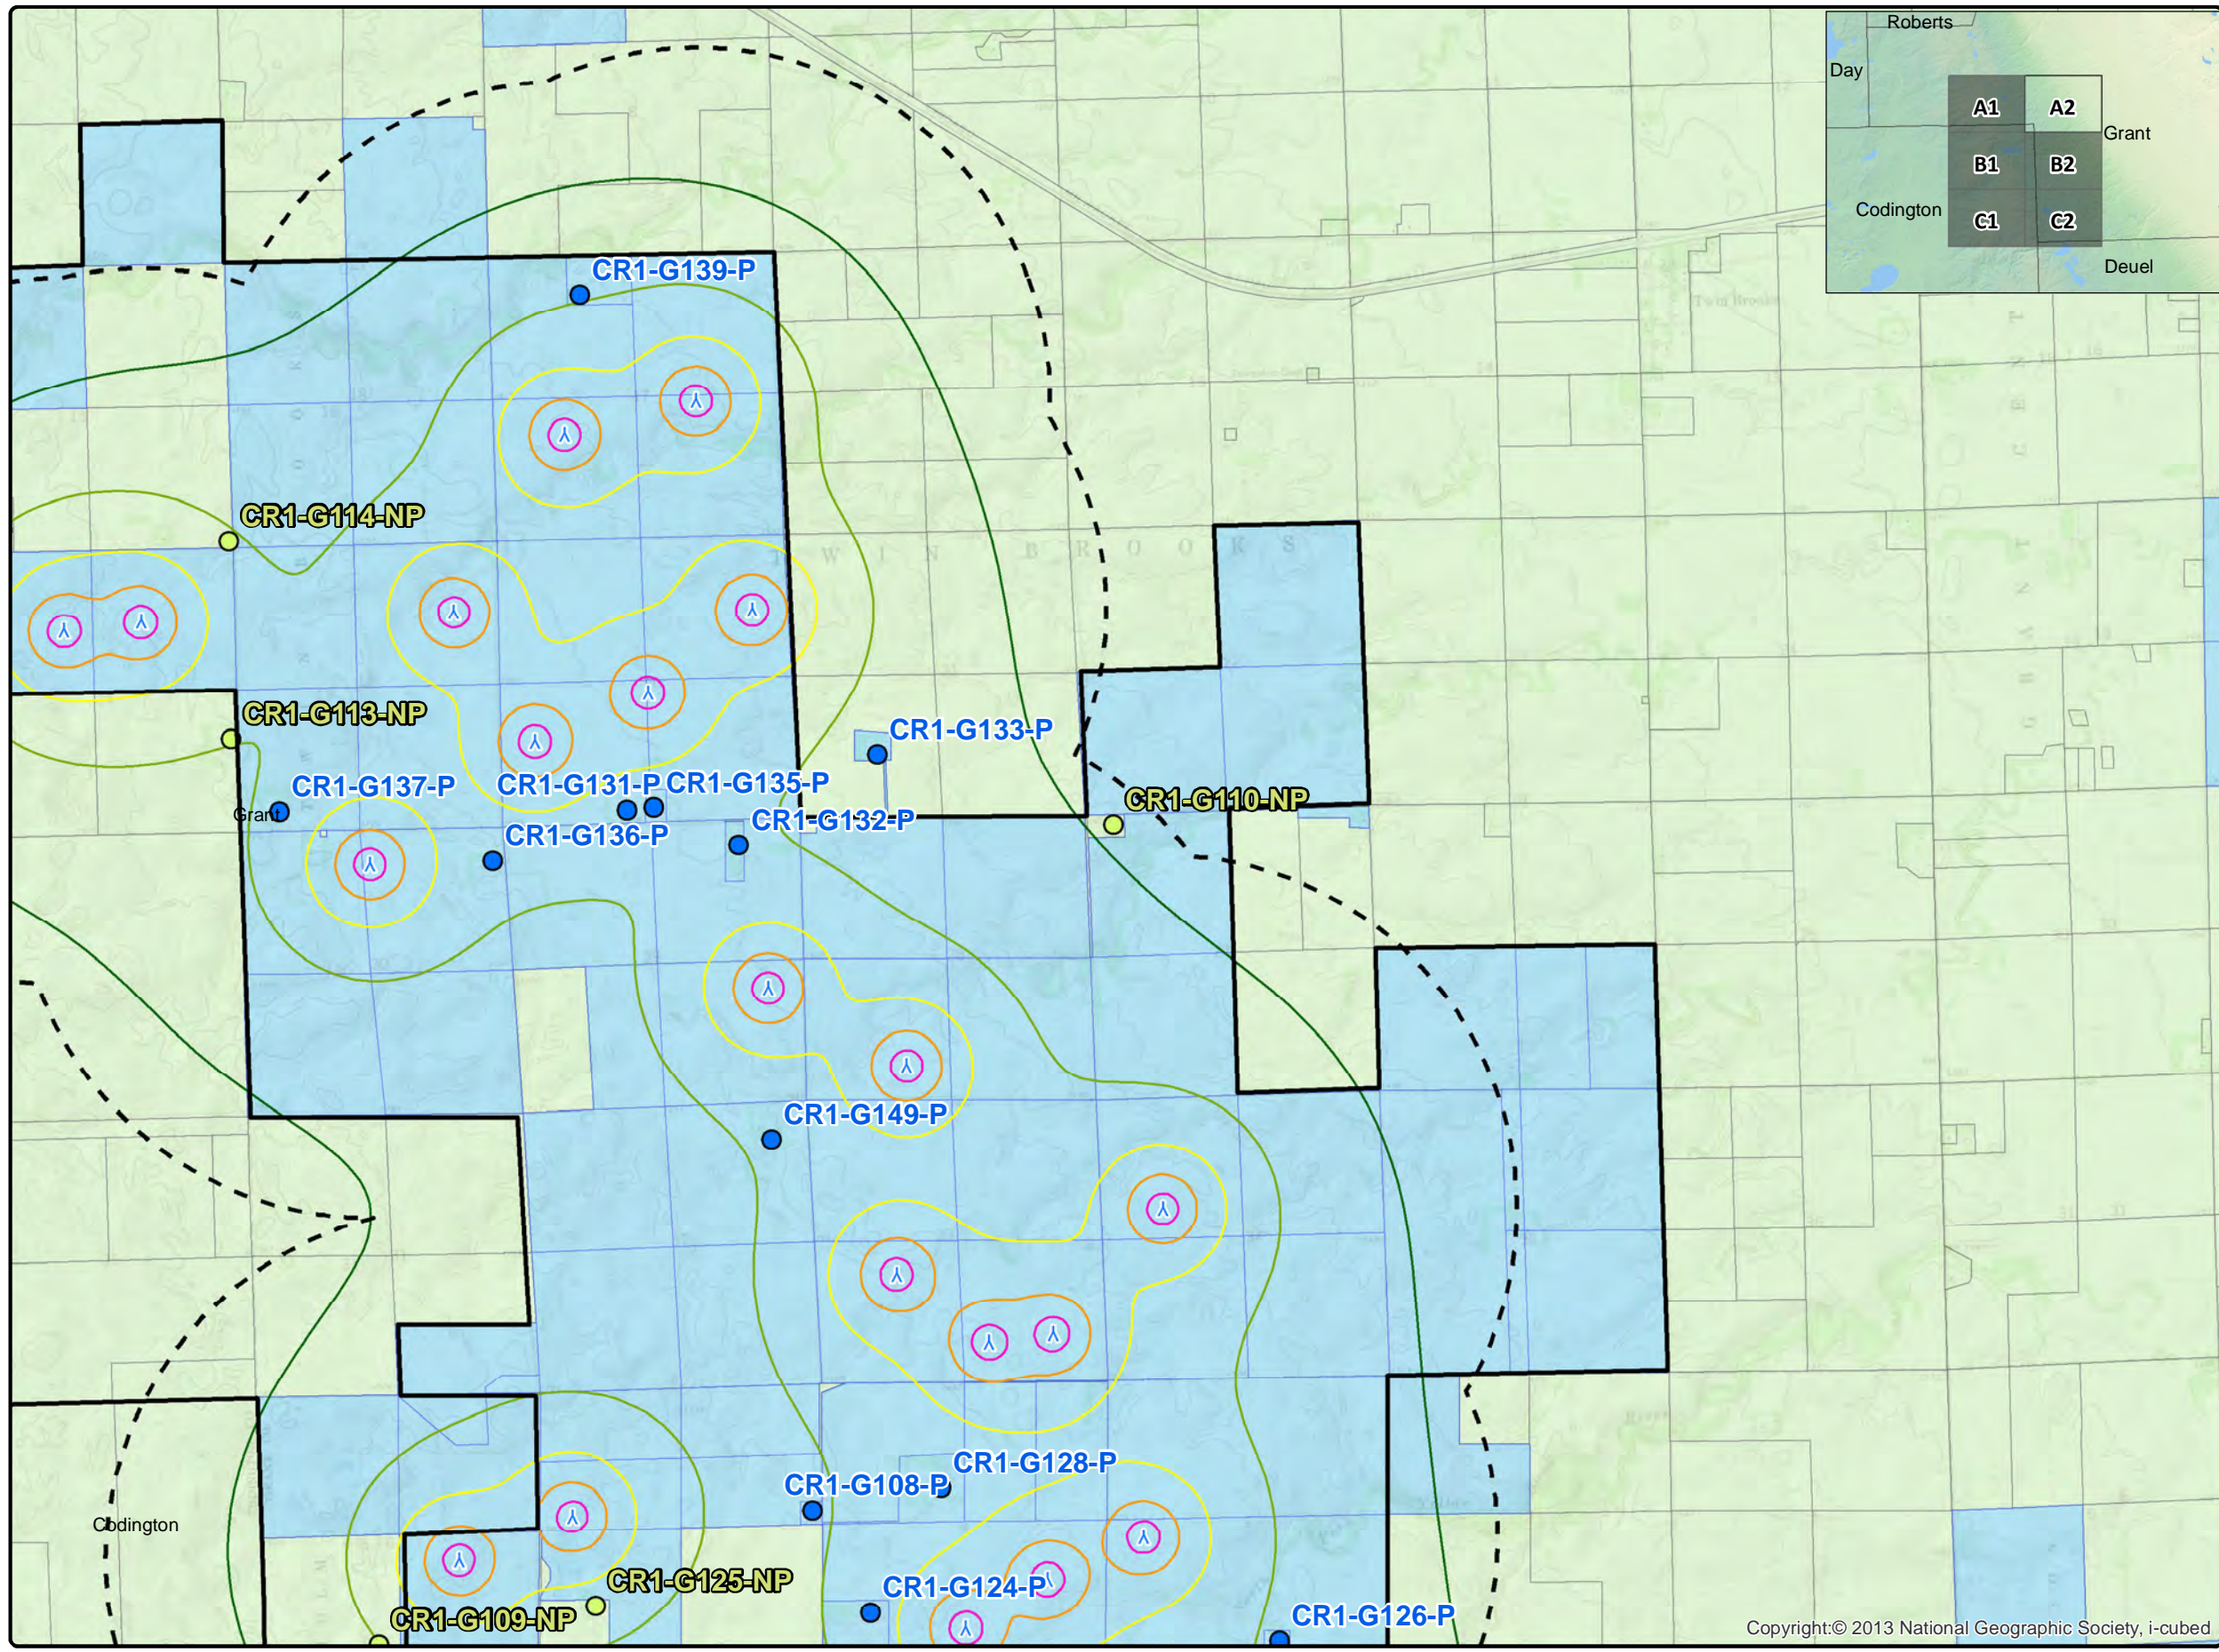

Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.



www.eapc.net | 701.775.3000

**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.

Predicted sound pressure levels at existing residences and land parcel boundaries.

Additional 2 dBA added.

Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431

Issue Dates

#	Description	Date
1	Original	2019.06.10

Drawn By: AS Checked By: JH

Legend

- Crowned Ridge Wind Turbines
- Crowned Ridge II Wind Turbines
- Dakota Range Wind Turbines
- 2 km Turbine Buffer
- County Lines
- CR1 Project Boundary
- Non Participants
- Participants




Sound Pressure (dBA)

- 35
- 40
- 45
- 50
- 55

Parcel Status

- Non-Participating Codington Parcels
- Participating Codington Parcels
- Participating Parcels
- Pending Parcels
- Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

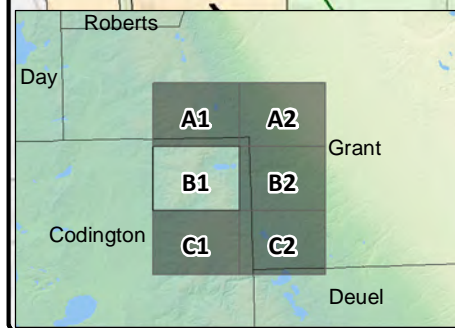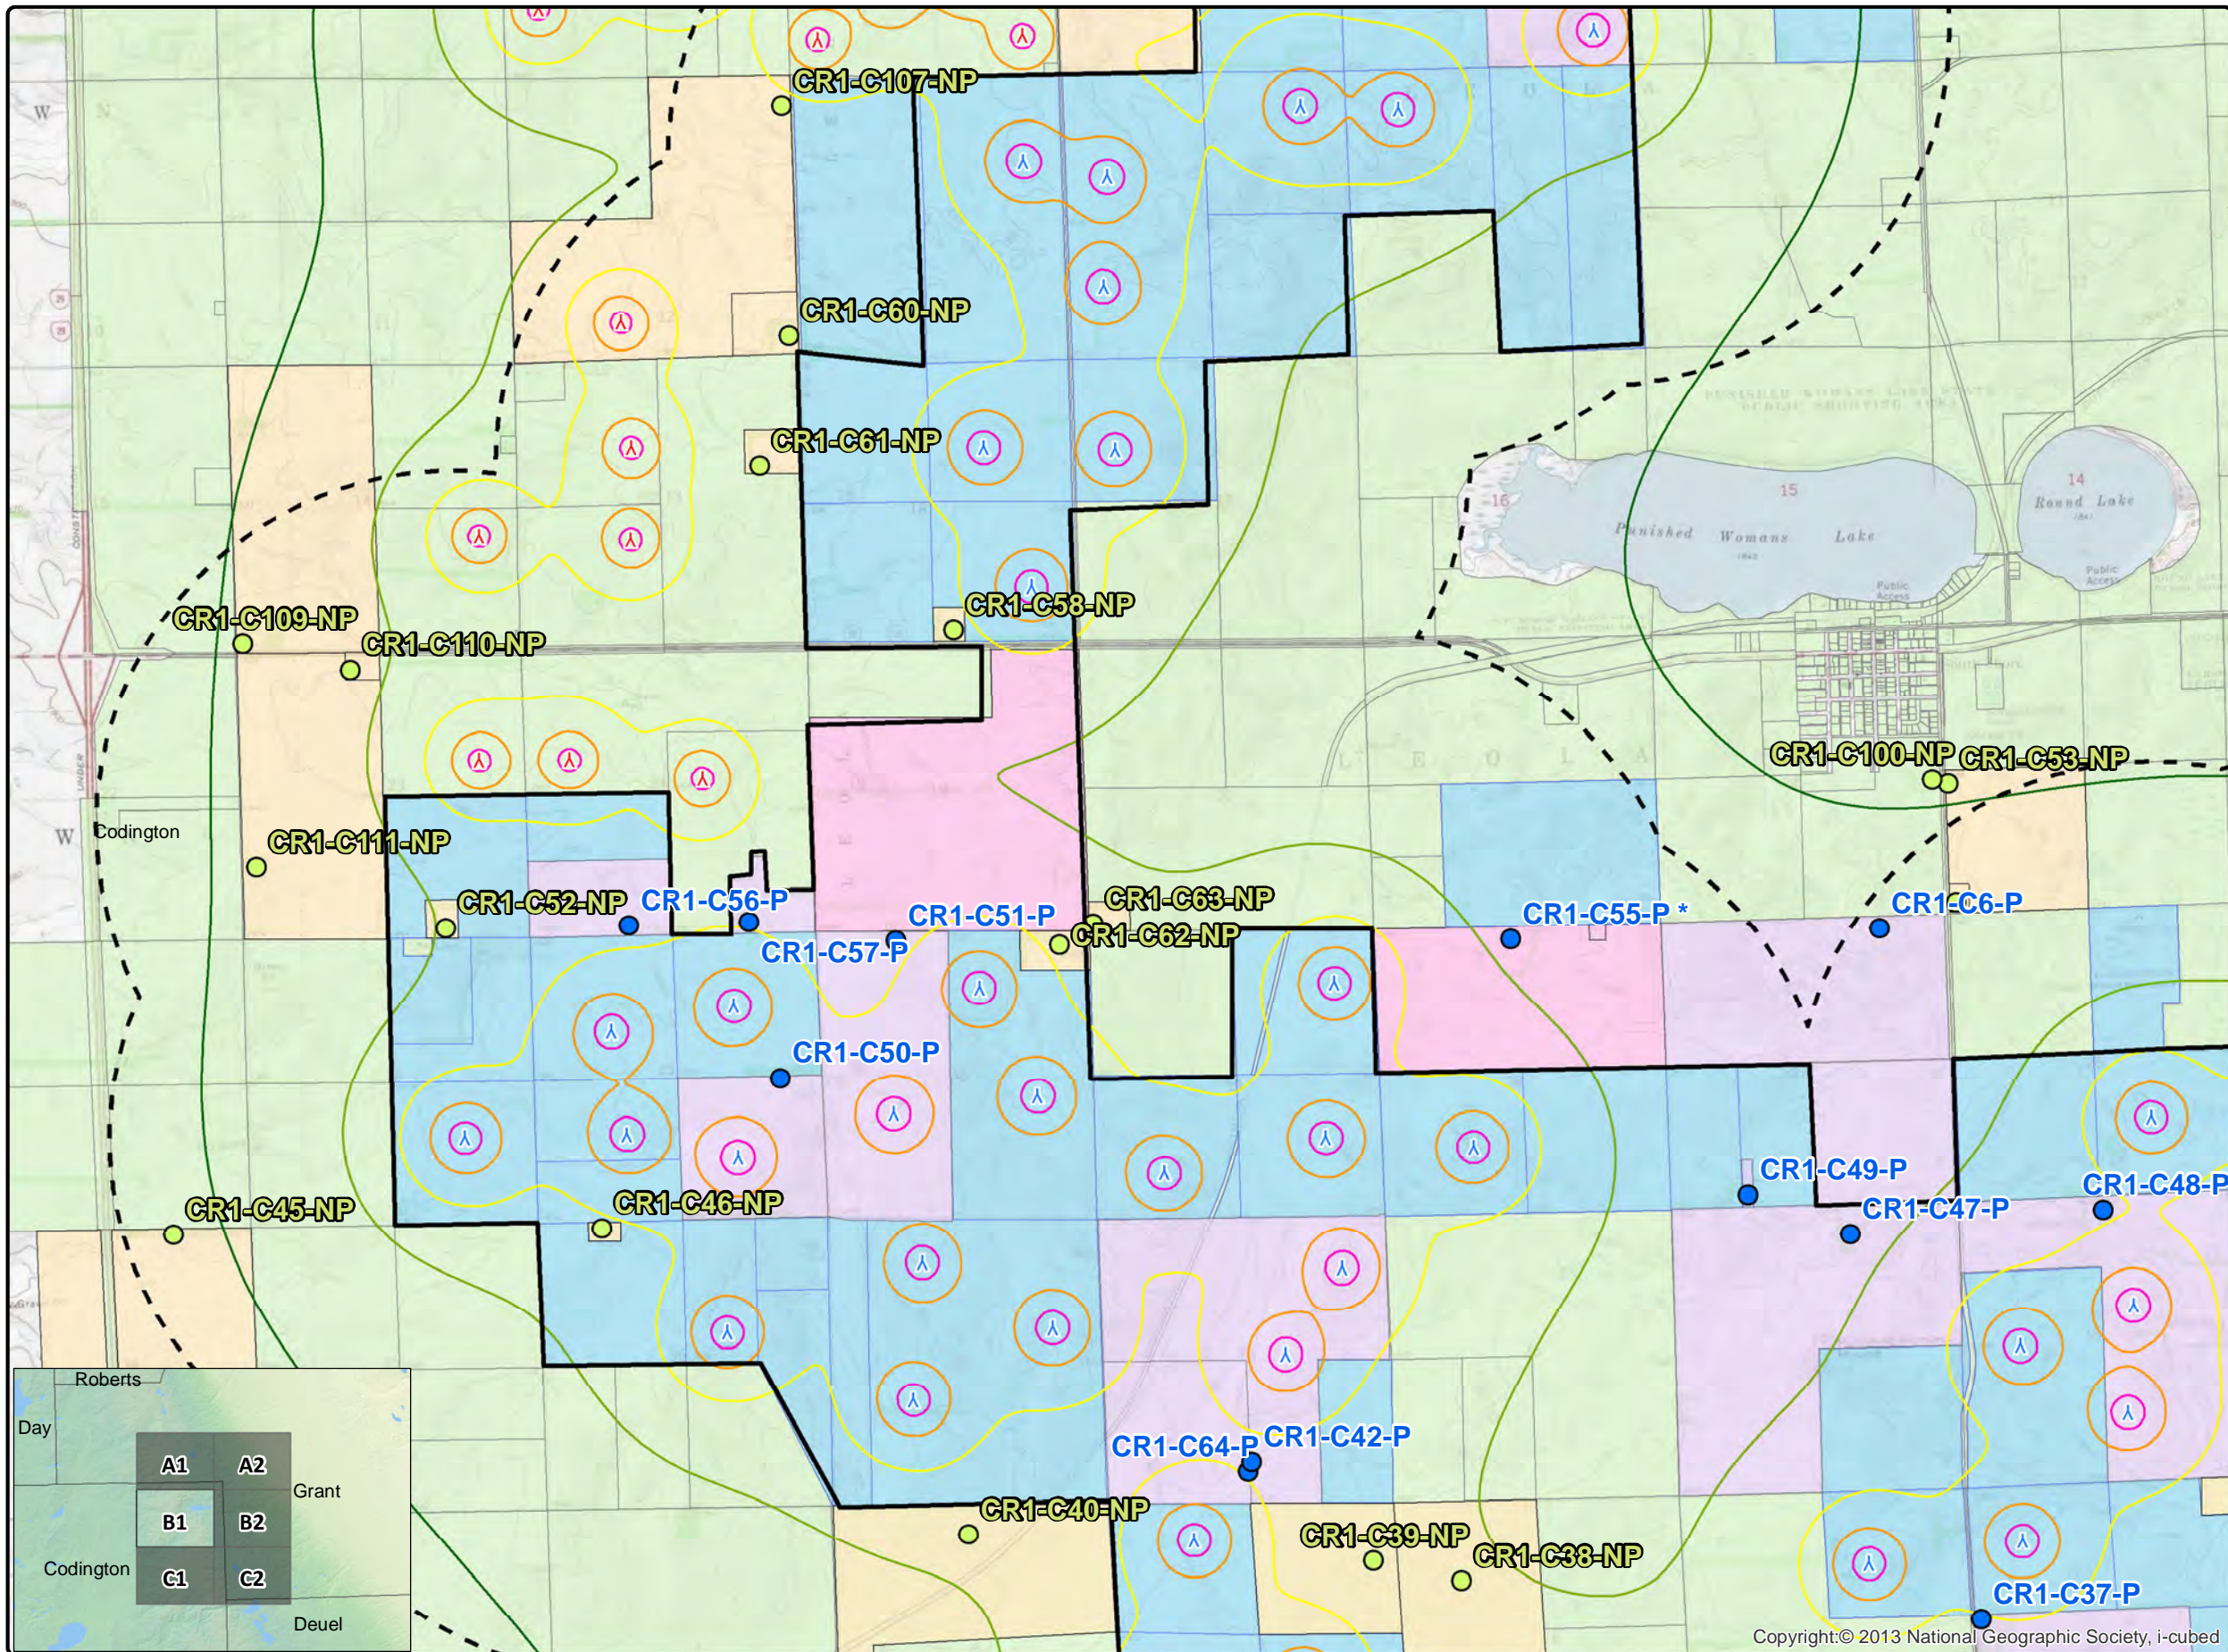

Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.



www.eapc.net | 701.775.3000

**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.

Predicted sound pressure levels at existing residences and land parcel boundaries.

Additional 2 dBA added.

Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431

Issue Dates

#	Description	Date
1	Original	2019.06.10

Drawn By: AS Checked By: JH

Legend



- Crowned Ridge Wind Turbines
- Crowned Ridge II Wind Turbines
- Dakota Range Wind Turbines
- 2 km Turbine Buffer
- County Lines
- CR1 Project Boundary
- Non Participants
- Participants

Sound Pressure (dBA)

- 35
- 40
- 45
- 50
- 55

- Non-Participating Codington Parcels
- Participating Codington Parcels
- Participating Parcels
- Pending Parcels
- Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

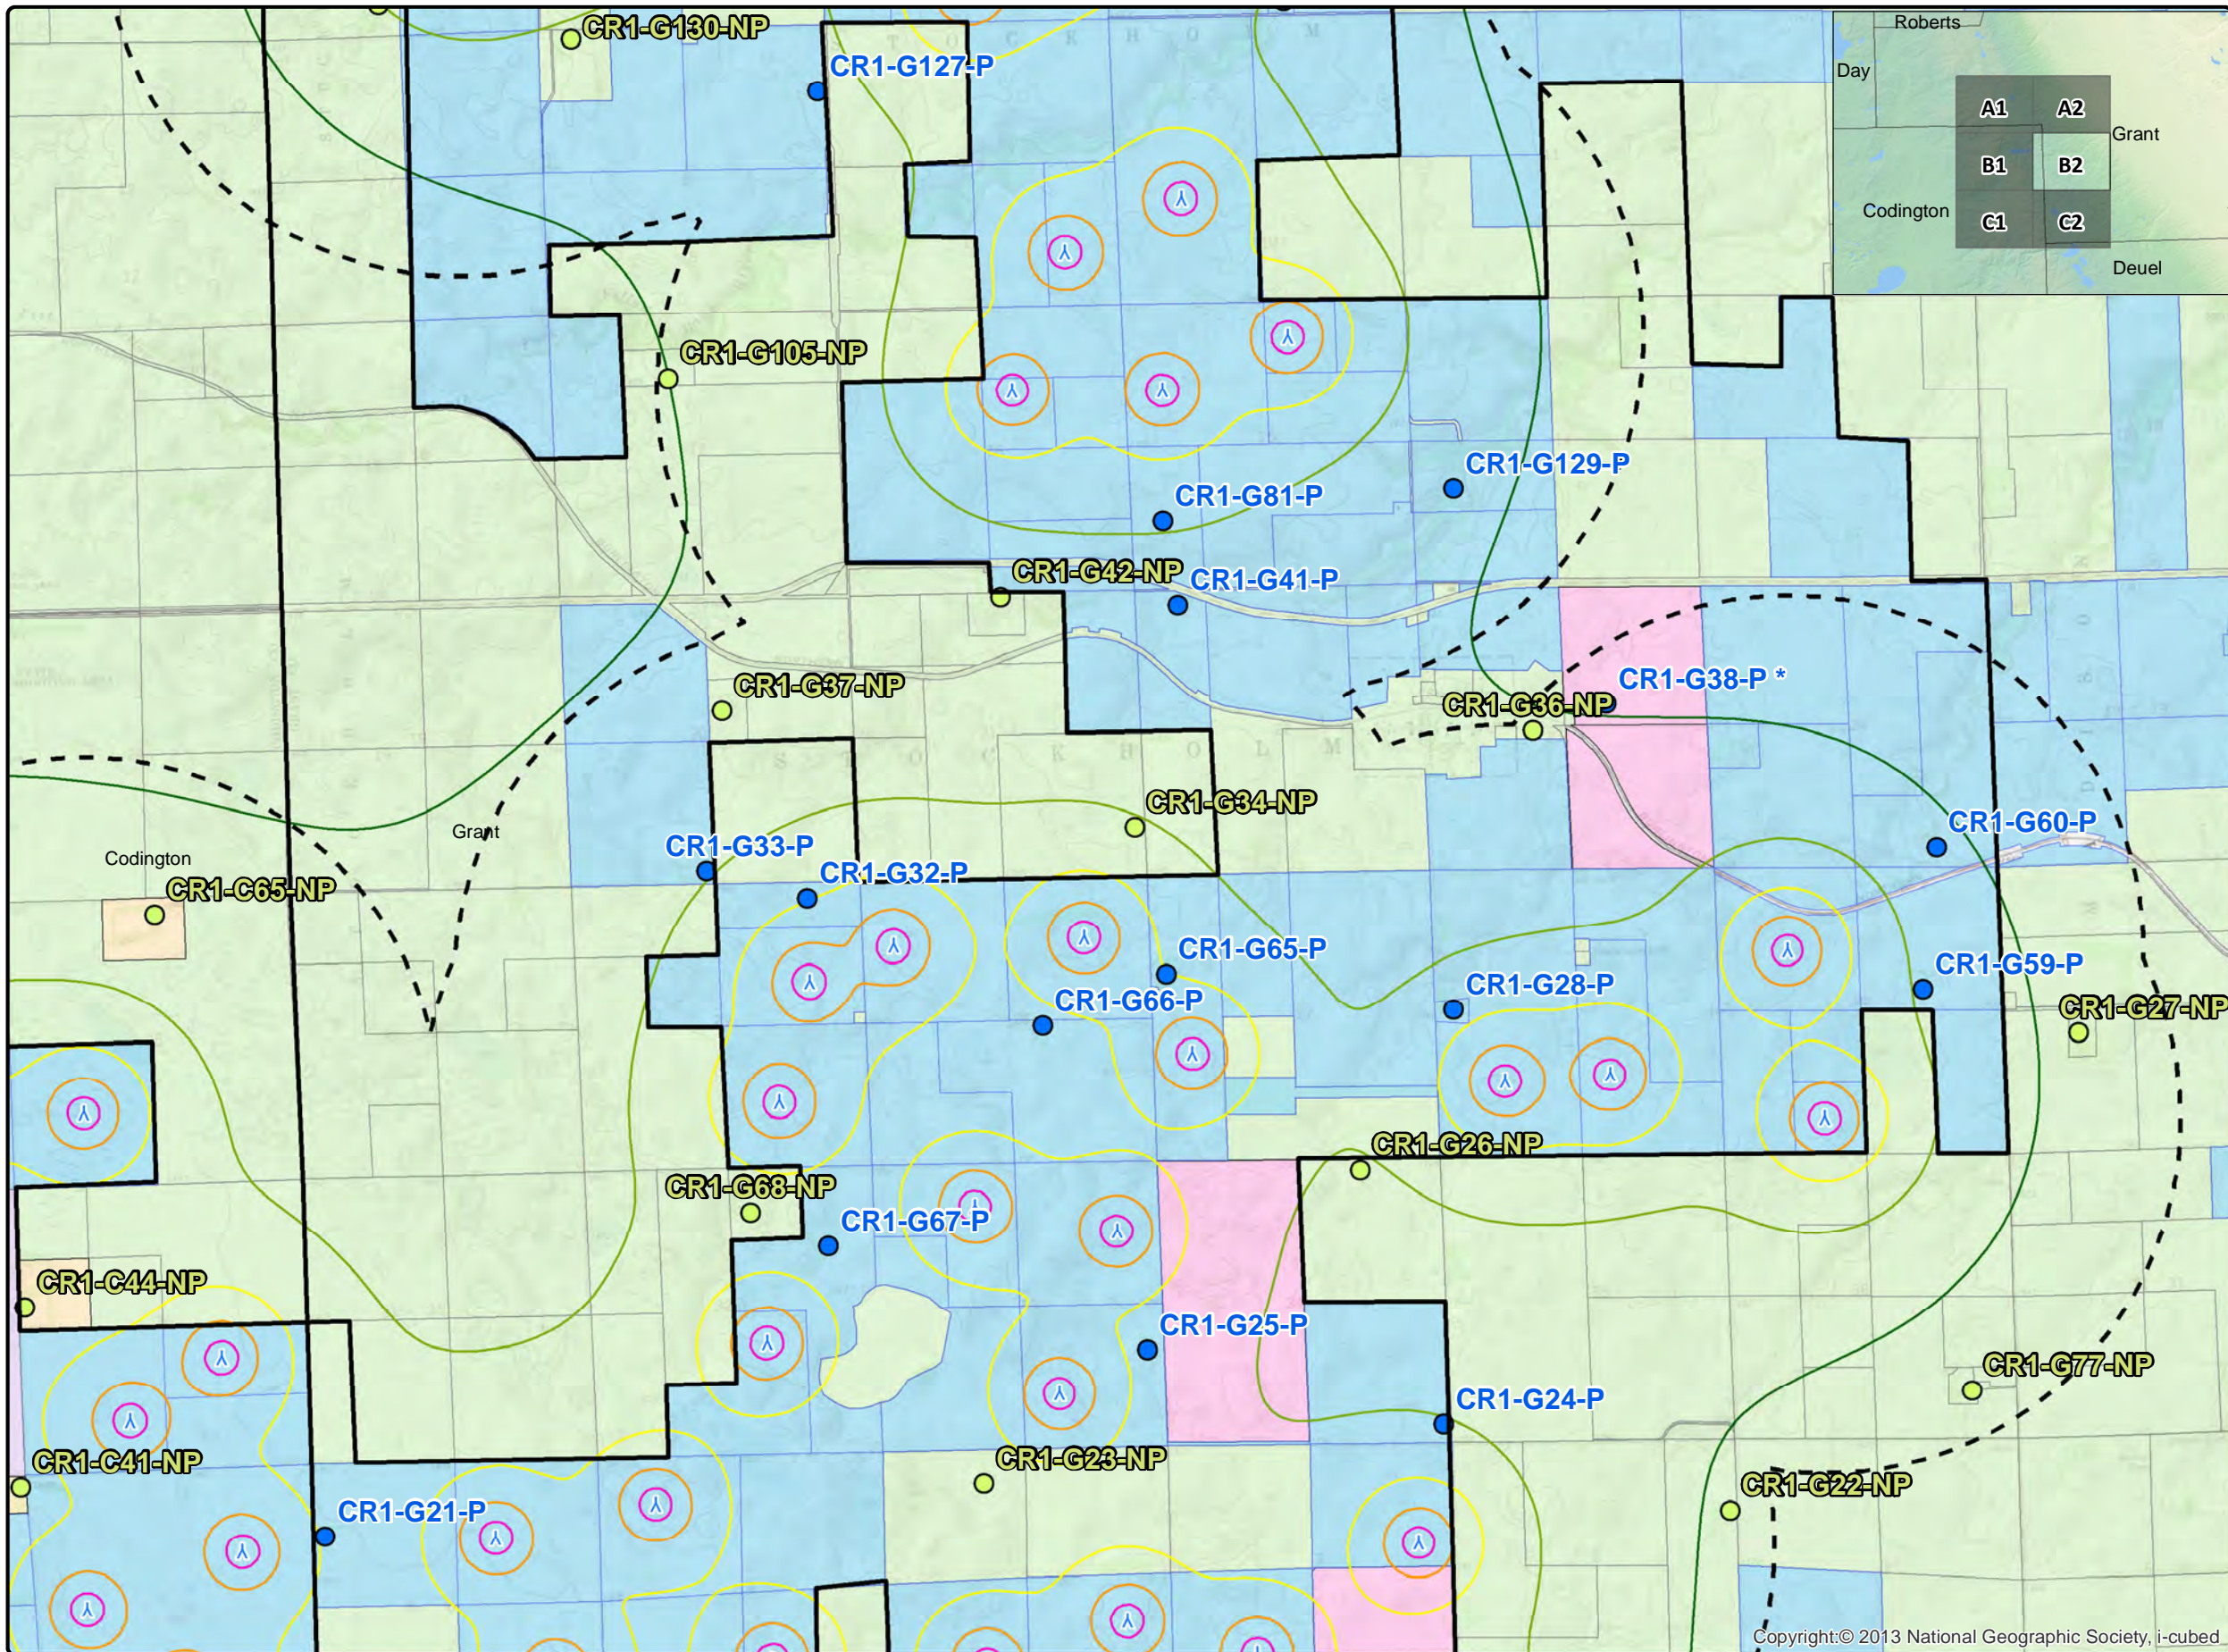

Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.



www.eapc.net | 701.775.3000

**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.
Predicted sound pressure levels at existing residences and land parcel boundaries.
Additional 2 dBA added.
Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431

Issue Dates

#	Description	Date
1	Original	2019.06.10

Drawn By: AS *Checked By: JH*

#	Description	Date
1	Original	2019.06.10

Legend

- Crowned Ridge Wind Turbines
- Crowned Ridge II Wind Turbines
- Dakota Range Wind Turbines
- 2 km Turbine Buffer
- County Lines
- CR1 Project Boundary
- Non Participants
- Participants




Sound Pressure (dBA)

- 35
- 40
- 45
- 50
- 55

Parcel Status

- Non-Participating Codington Parcels
- Participating Codington Parcels
- Participating Parcels
- Pending Parcels
- Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

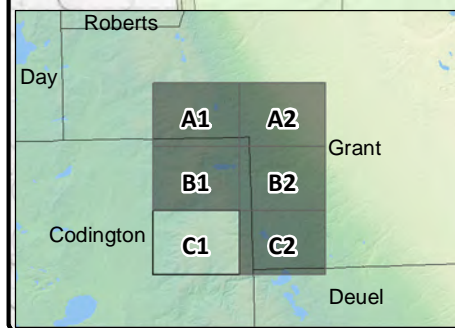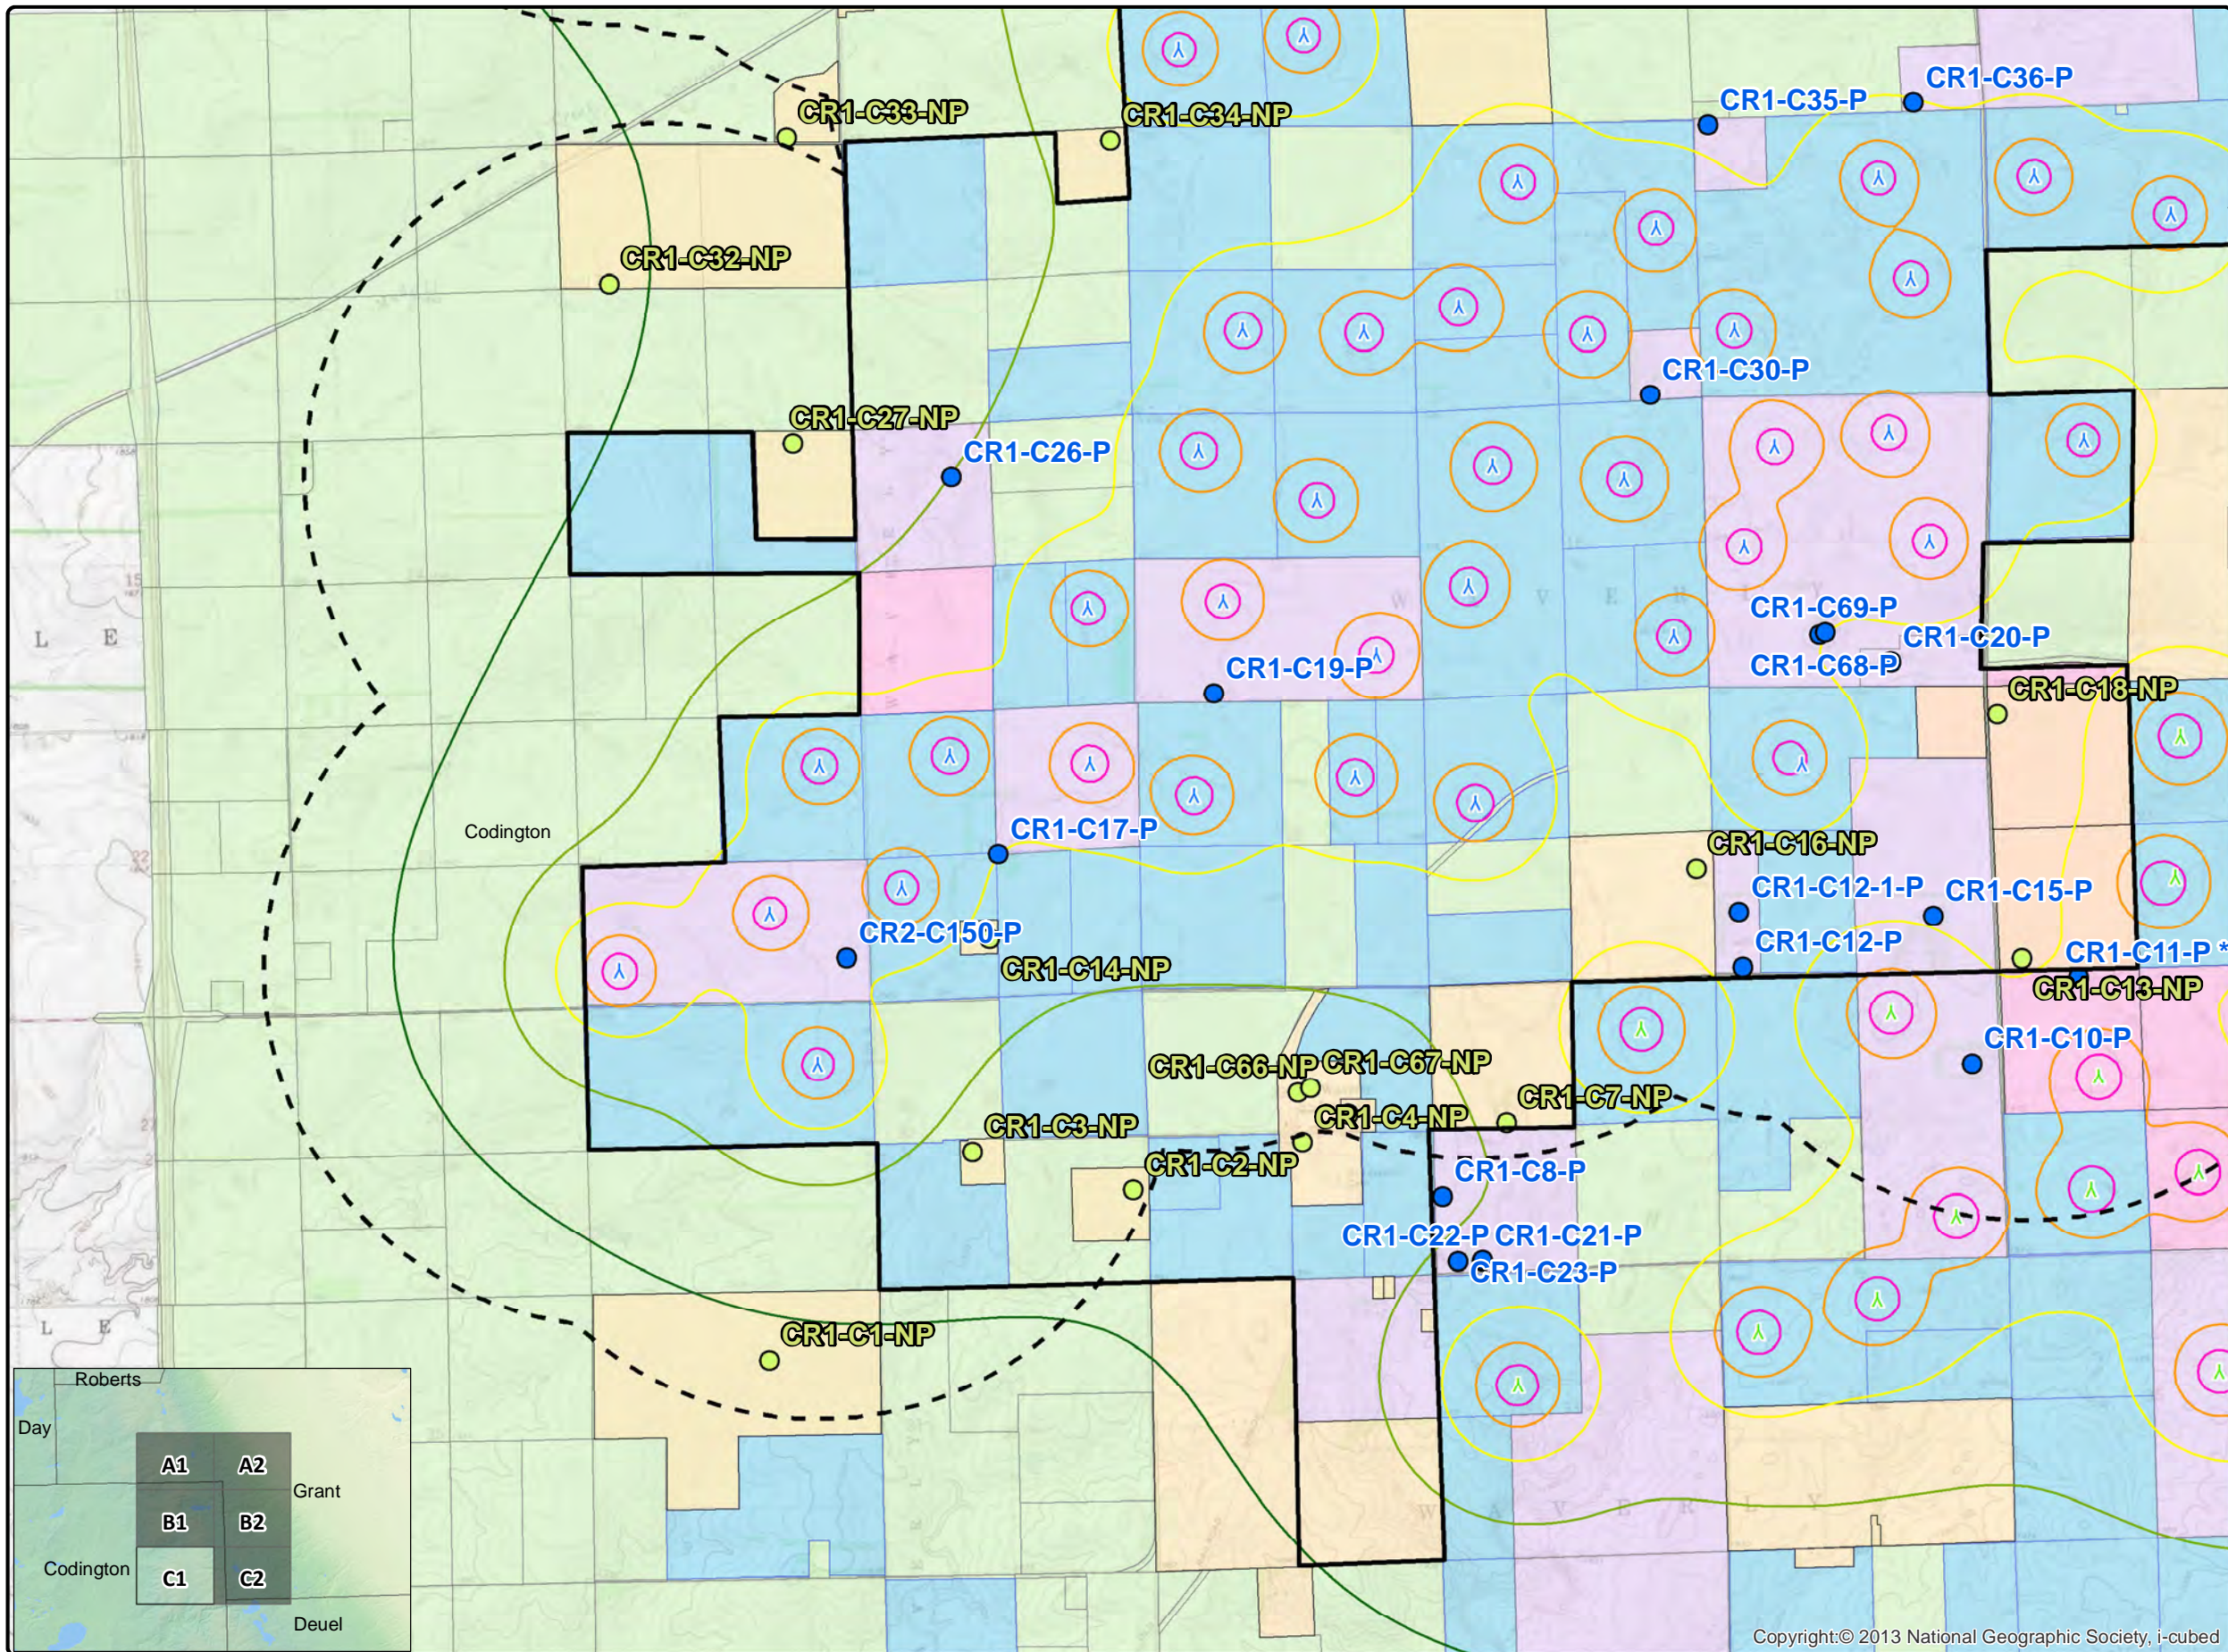

Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.



**Crowned Ridge Wind Farm
Sound Pressure Iso-Lines**

Client
SWCA Environmental Consultants

Project Description
Wind turbine layout with occupied structures and parcel boundaries within 2 km.
Predicted sound pressure levels at existing residences and land parcel boundaries.
Additional 2 dBA added.
Includes all proposed turbine changes.

Location: Watertown, SD
Project #: 20174431

Issue Dates

#	Description	Date
1	Original	2019.06.10

Drawn By: AS *Checked By: JH*

Legend

- Crowned Ridge Wind Turbines
- Crowned Ridge II Wind Turbines
- Dakota Range Wind Turbines
- 2 km Turbine Buffer
- County Lines
- CR1 Project Boundary
- Non Participants
- Participants

Sound Pressure (dBA)

- 35
- 40
- 45
- 50
- 55

- Non-Participating Codington Parcels
- Participating Codington Parcels
- Participating Parcels
- Pending Parcels
- Non-Participating Parcels

Legend



- Crowned Ridge Wind Turbines
- Crowned Ridge II Wind Turbines
- Dakota Range Wind Turbines
- 2 km Turbine Buffer
- County Lines
- CR1 Project Boundary
- Non Participants
- Participants

Sound Pressure (dBA)

- 35
- 40
- 45
- 50
- 55

- Non-Participating Codington Parcels
- Participating Codington Parcels
- Participating Parcels
- Pending Parcels
- Non-Participating Parcels

COPYRIGHT:
All maps, plans, specifications, computer files, field data, notes and other documents and instruments prepared by EAPC as instruments of service shall remain the property of EAPC. EAPC shall retain all common law, statutory and other reserved rights, including the copyright thereto.

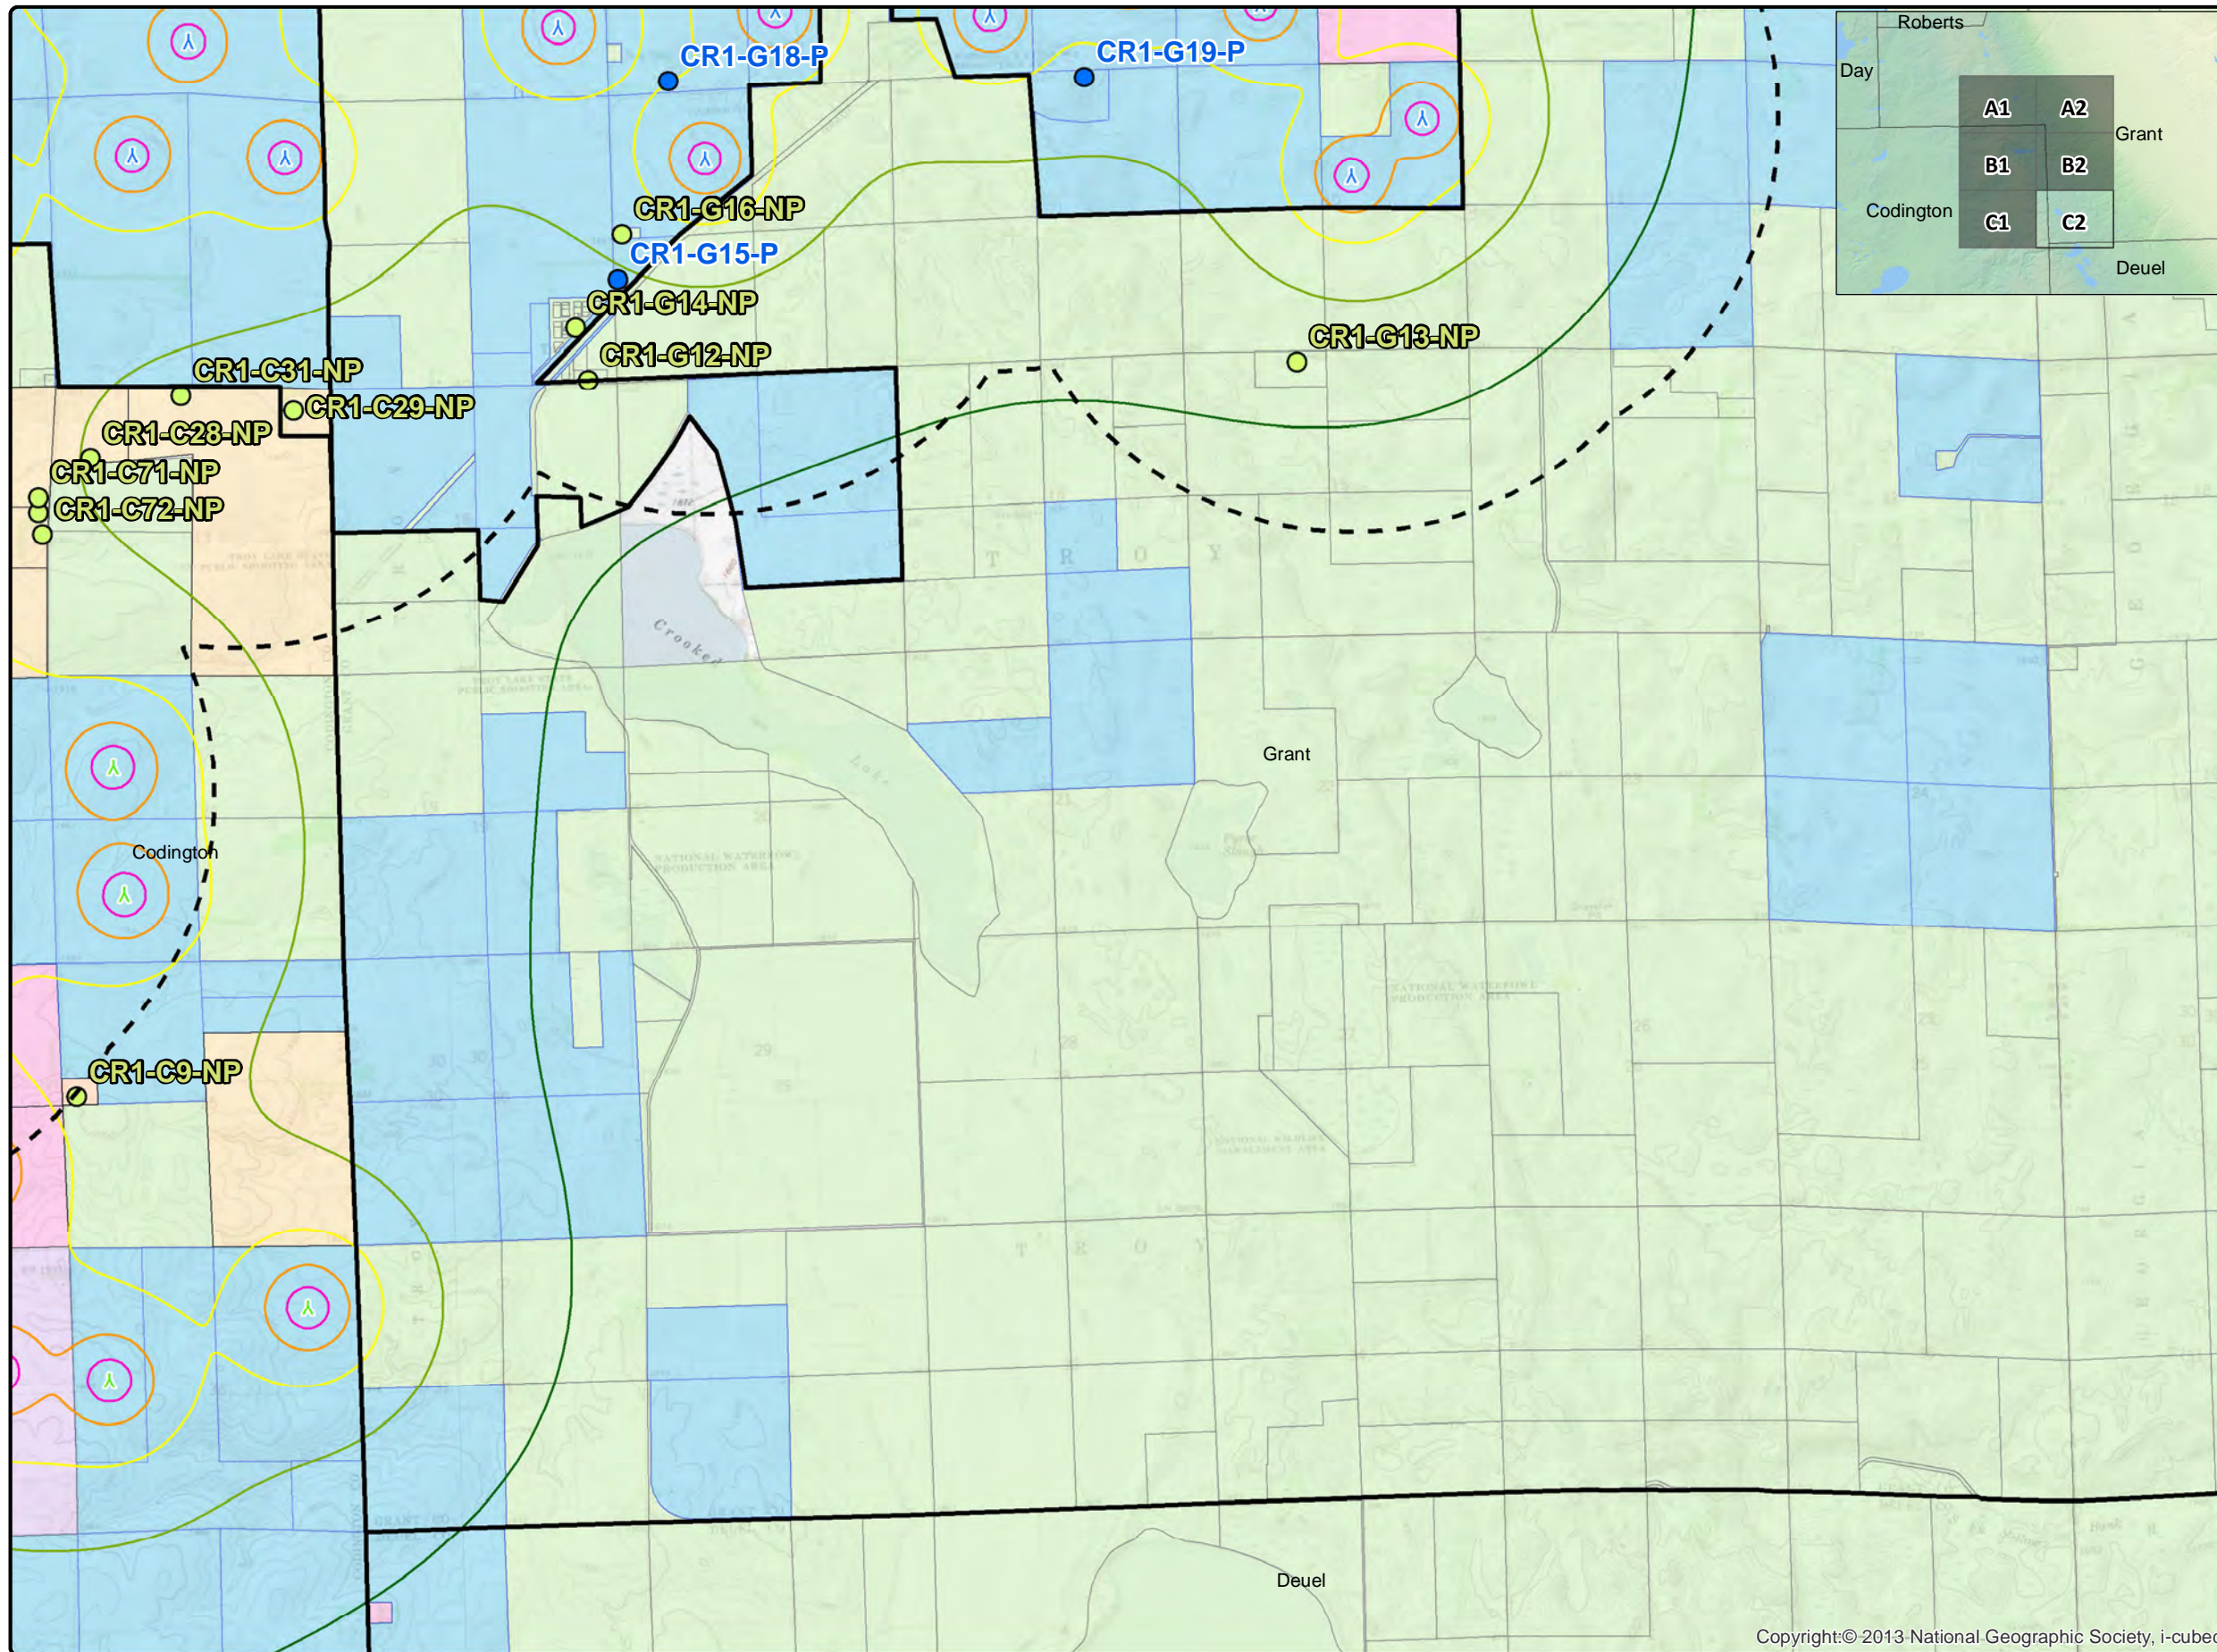

Neither EAPC nor any person acting on their behalf: (a) makes any warranty, express or implied, with respect to the use of any information disclosed on this drawing; or (b) assumes any liability with respect to the use of any information or methods disclosed on this drawing. Any recipient of this document, by their acceptance or use of this document, releases EAPC, its parent corporations and its affiliates, from any liability for direct, indirect, consequential, or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence, and strict liability. The responsibilities for the applications and use of the material contained in this document remain solely with the client.