7.

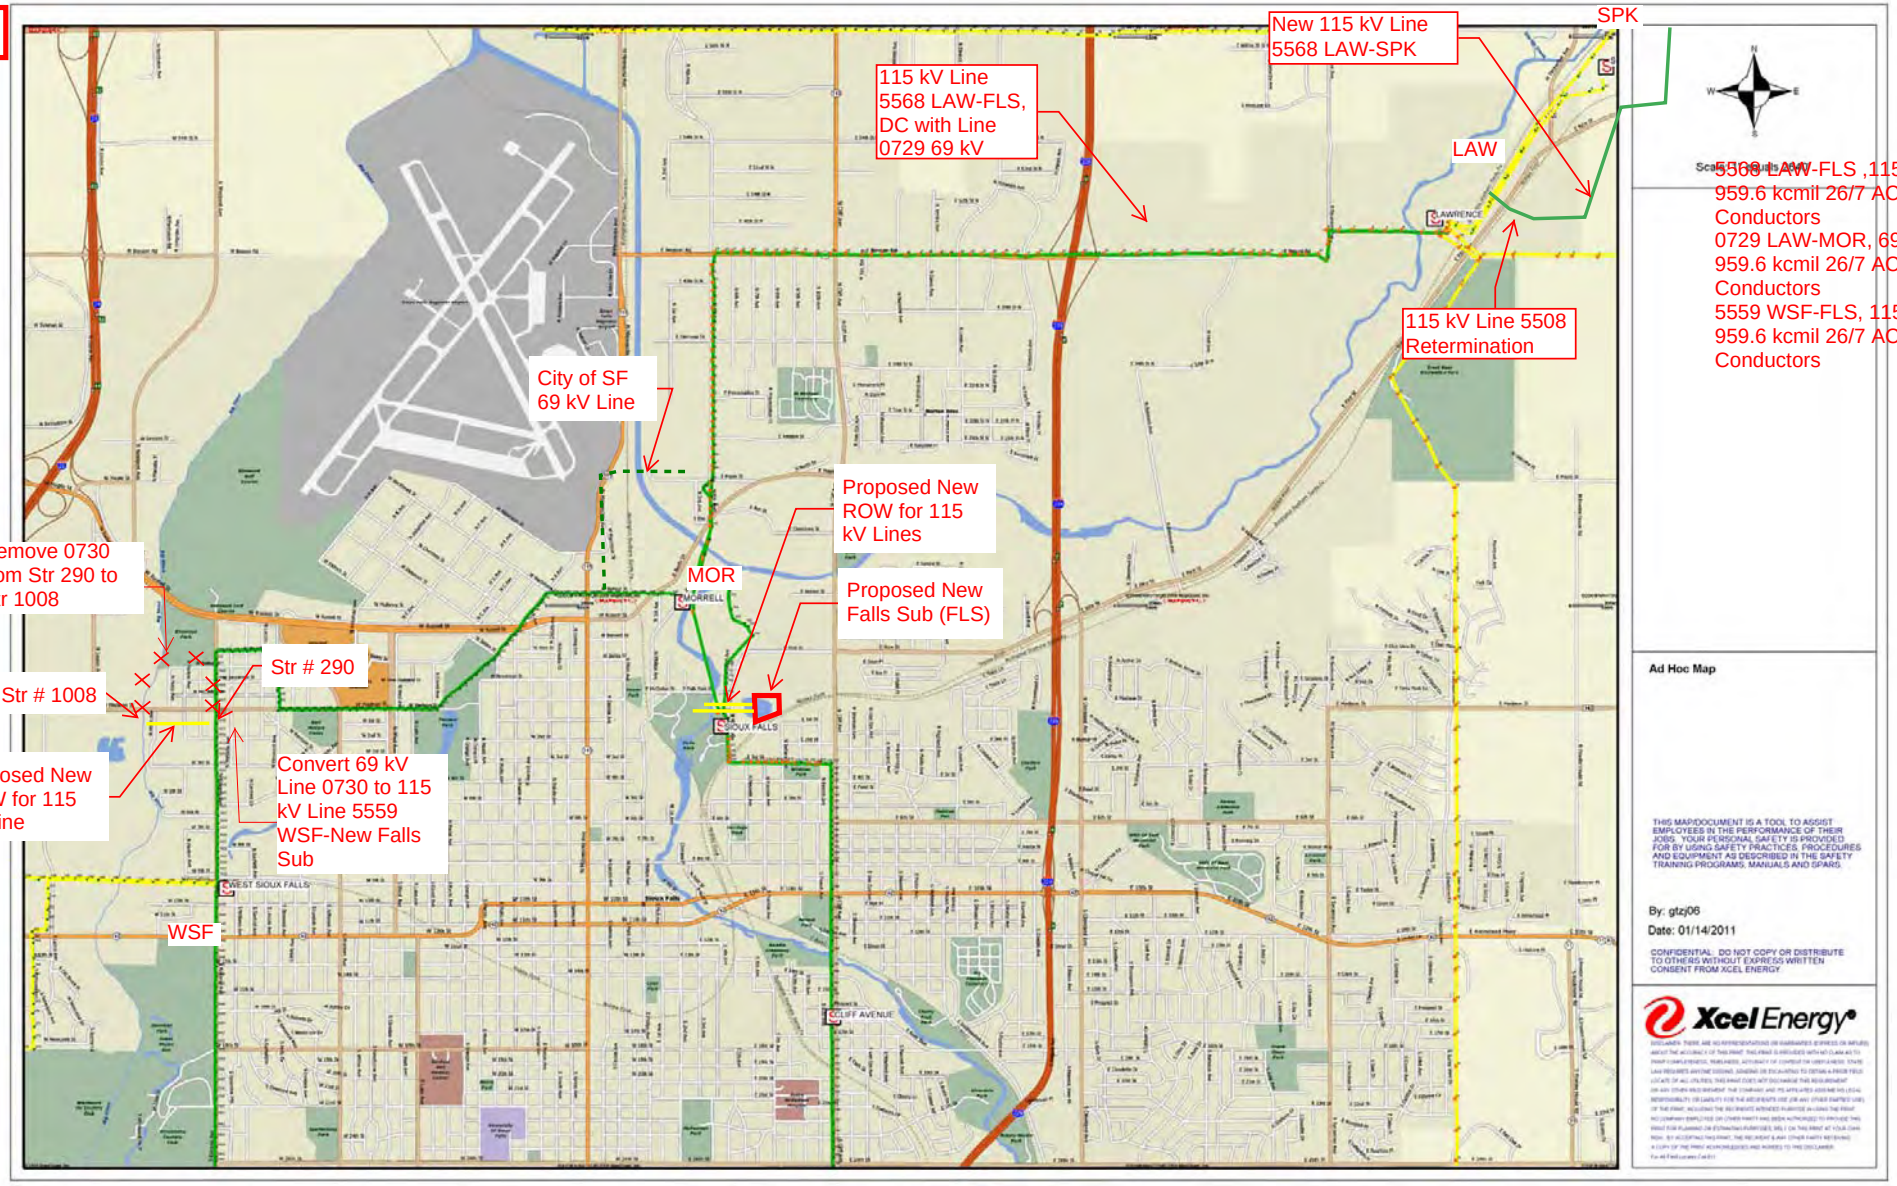
New 115 kV Line
5568 LAW-SPK
SPK
115 kV Line
5568 LAW-FLS,
DC with Line
0729 69 kV
LAW
5568 LAW-FLS ,115 kV,
959.6 kcmil 26/7 ACSS
Conductors
0729 LAW-MOR, 69 kV
959.6 kcmil 26/7 ACSS
Conductors
5559 WSF-FLS, 115 kV,
959.6 kcmil 26/7 ACSS
Conductors
115 kV Line 5508
Retermination
City of SF
69 kV Line
Proposed New
ROW for 115
kV Lines
MOR
Proposed New
Falls Sub (FLS)
Remove 0730
from Str 290 to
Str 1008
Str # 290
Str # 1008
Proposed New
ROW for 115
kV Line
Convert 69 kV
Line 0730 to 115
kV Line 5559
WSF-New Falls
Sub
WSF
Ad Hoc Map
By: gtzj06
Date: 01/14/2011
Xcel Energy