


Exhibit MH-2

Exhibit MH-2.1 Load Location - Service Territory Proximity

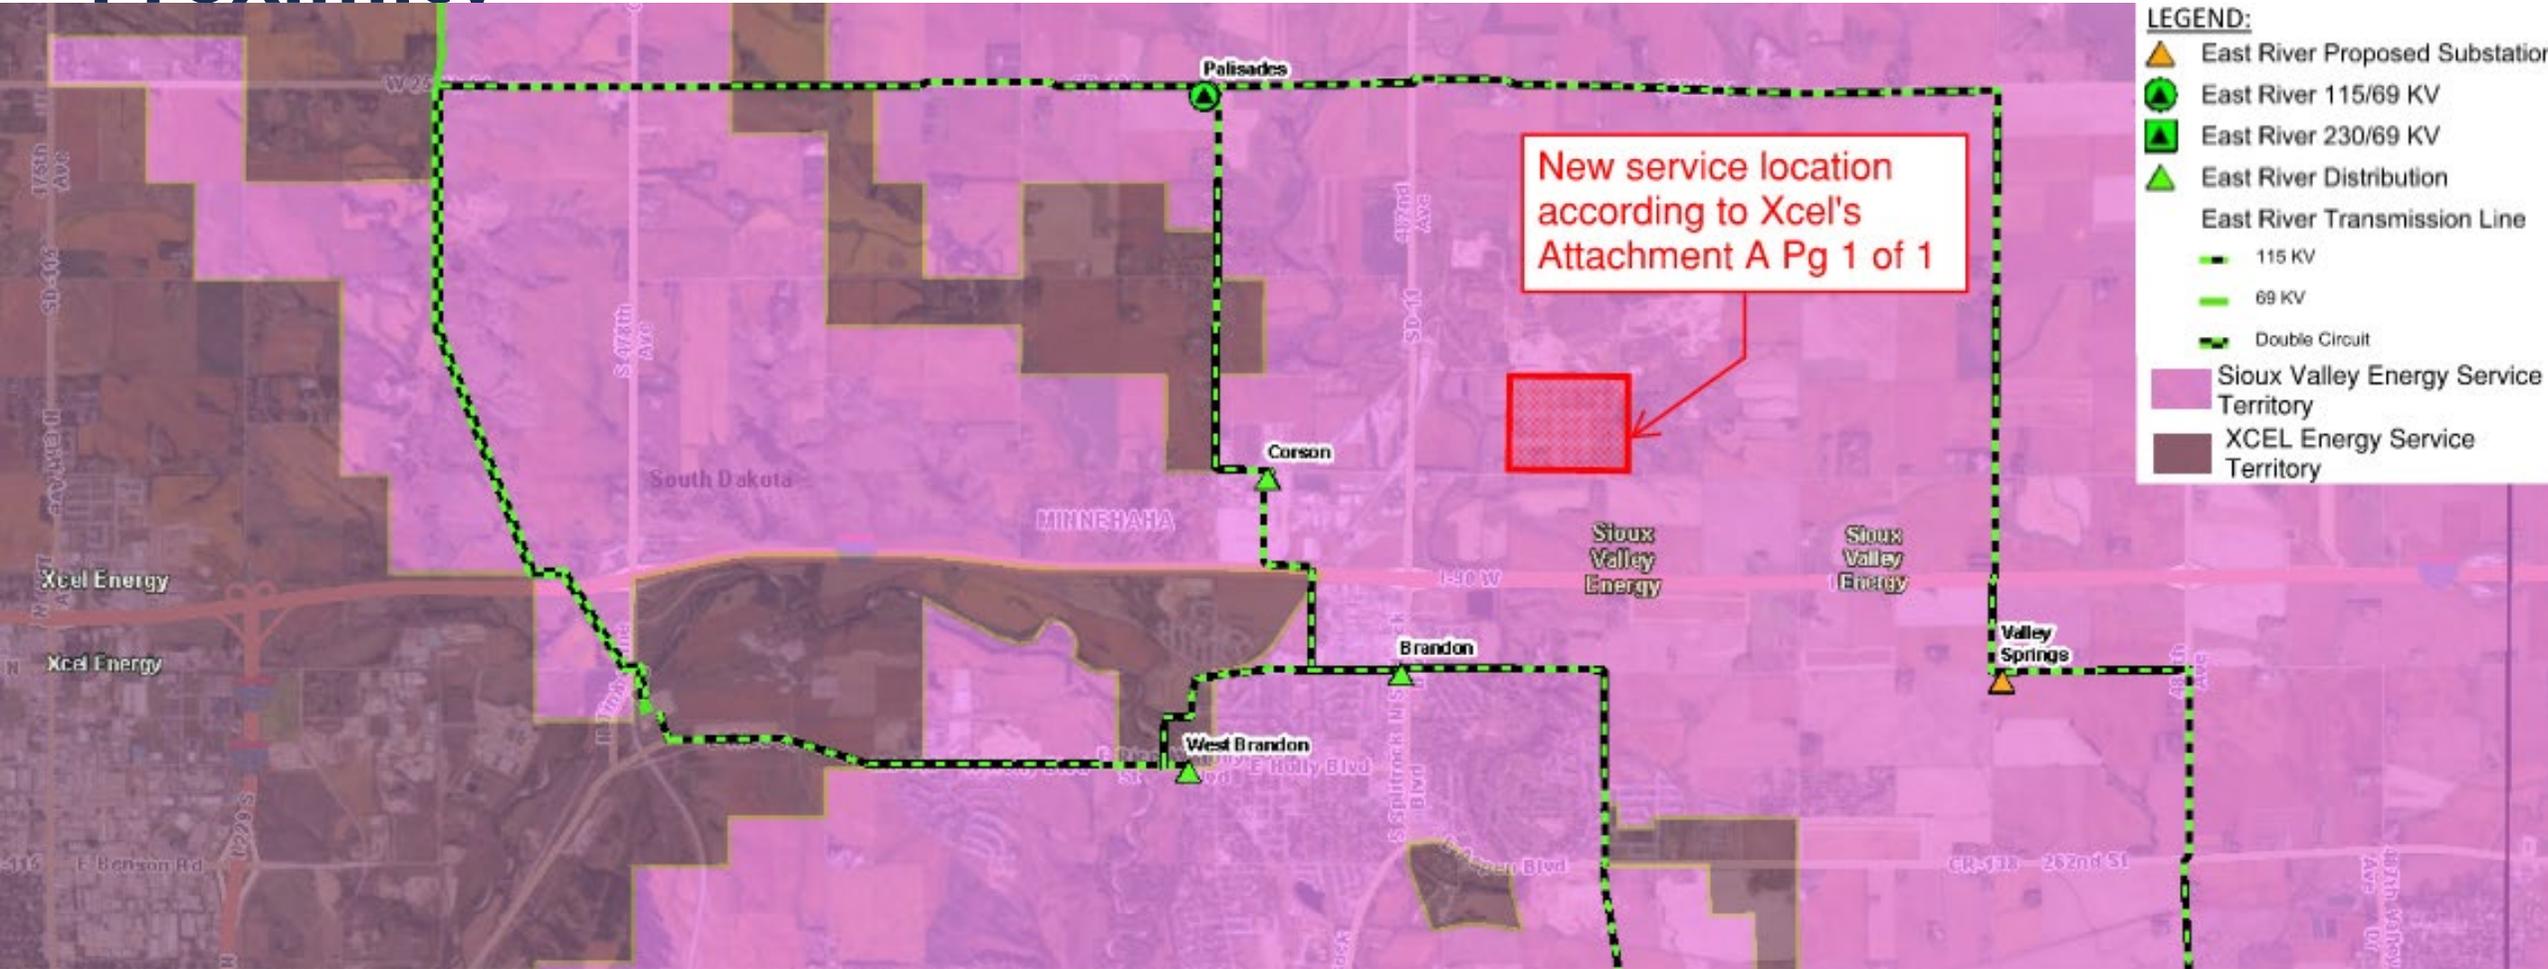

LEGEND:

- ▲ East River Proposed Substation
- East River 115/69 KV
- East River 230/69 KV
- ▲ East River Distribution
- East River Transmission Line
 - 115 KV
 - 69 KV
 - Double Circuit
- Sioux Valley Energy Service Territory
- XCEL Energy Service Territory

New service location according to Xcel's Attachment A Pg 1 of 1



Exhibit MH-2.2 Load Location – EREPC System Proximity



Exhibit MH 2.3 Load Location - EREPC 115 kV Transmission Loop Proximity

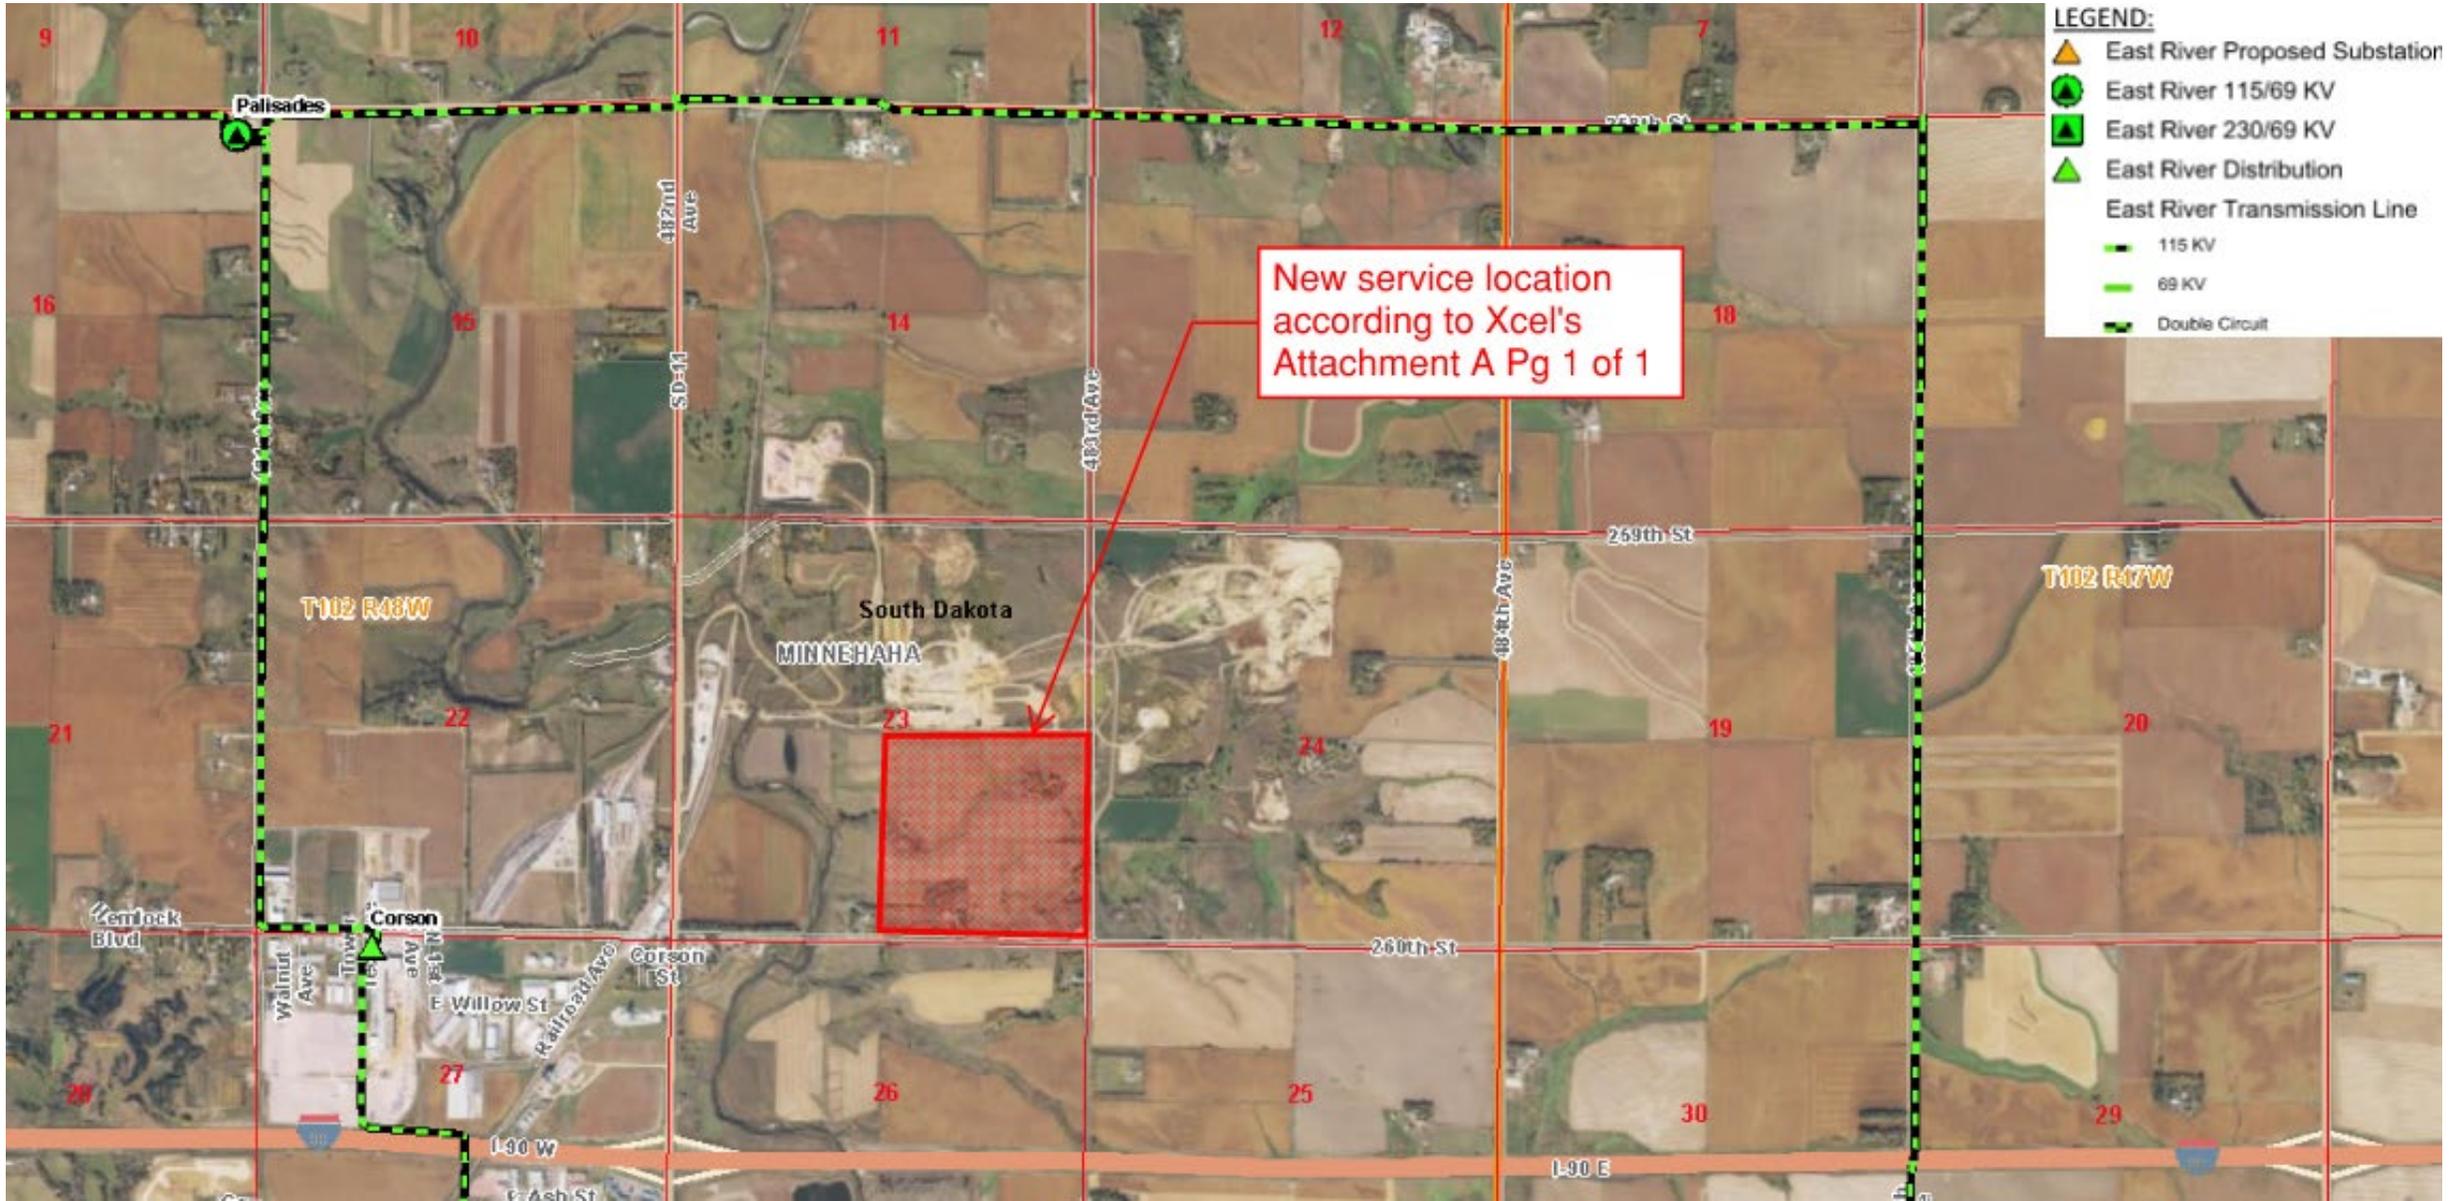


Exhibit MH-2.4 Load Location - EREPC Corson Sub

